

Technical Information

STR700 SmartLine Remote Diaphragm Seals
Specification 34-ST-03-104, October 2020**Introduction**

Part of the SmartLine® family of products, the STR700 is a series of pressure transmitters hydraulically matched and optimized with a complete set of remote diaphragm seals. Utilizing the same high performance sensor technology of the ST 800 product line Honeywell has optimized the mechanical and hydraulic designs in order to minimize the typical effects of temperature on remote seal systems. The SmartLine family is also fully tested and compliant with Experion® PKS providing the highest level of compatibility assurance and integration capabilities. SmartLine easily meets the most demanding application needs for pressure measurement applications.

Best in Class Transmitter Features:

- Accuracies up to 0.075% of span
- Automatic static pressure & temperature compensation
- Rangeability up to 100:1
- Alphanumeric display capabilities
- External zero, span, & configuration capability
- Polarity insensitive electrical connections
- Comprehensive on-board diagnostic capabilities
- Integral Dual Seal design for highest safety based on ANSI/NFPA 70-202 and ANSI/ISA 12.27.0
- World class overpressure protection
- Full compliance to SIL 2/3 requirements.
- Modular design characteristics
- Available with additional 4-year warranty

Span & Range Limits:

Model	URL psid (bar)	LRL psid (bar)	Min Span psid (bar)
STR73D	100 (7.0)	-100 (-7.0)	0.9 (0.062)
STR74G	500 (35.0)	-14.7 (-1.0)	5 (0.35)

**Figure 1 – STR700 Remote Diaphragm Seal Unit****Typical Diaphragm Seal applications**

- High Process Temperatures
- Viscous or Suspended Solids
- Highly Corrosive Process Materials
- Sanitary Applications
- Applications with Hydrogen Permeation Possibilities
- Level Applications with Maintenance Intensive Wet Legs
- Applications requiring remote Transmitter Mounting
- Tank Applications with Density or Interface Measurements

Communications/Output Options:

- Honeywell Digitally Enhanced (DE)
- HART ® (version 7.0)
- FOUNDATION™ Fieldbus

All transmitters are available with the above listed communications protocols.

Description

The SmartLine family pressure transmitters are designed around a high performance piezo-resistive sensor. This one sensor integrates multiple sensors linking process pressure measurement with on-board static pressure (DP Models) and temperature compensation measurements. This level of performance allows the ST 700 to replace most competitive transmitters available today.

Indication/Display Option

The ST 700 modular design accommodates a basic alphanumeric LCD display.

Basic Alphanumeric LCD Display Features

- Modular (may be added or removed in the field)
- 0, 90,180, & 270 degree position adjustments
- Configurable (HART only) and standard (Pa, KPa, MPa, KGcm2, Torr, ATM, inH₂O, mH₂O, bar, mbar, inH₂O, inHG, FTH₂O, mmH₂O, mm HG, & psi) measurement units
- 2 Lines 16 Characters (4.13H x 1.83W mm)
- Square root output indication (√)

Simple LCD Display Features

- Modular (may be added or removed in the field)
- Supports HART protocol variant
- 0, 90,180, & 270 degree position adjustments
- Configurable (HART only) and standard (Pa, KPa, MPa, KGcm2, Torr, ATM, inH₂O, mH₂O, bar, mbar, inH₂O, inHG, FTH₂O, mmH₂O, mm HG, & psi) measurement units.
- Supports Flow engineering units
- 2 Lines 6 digits PV (9.95H x 4.20W mm) 8 Characters
- Square root output indication (√) and Write protect Indication
- Built in Basic Device Configuration through Internal Buttons – Range/Engineering Unit/Loop Test /Loop Calibration/Zero /Span Setting

Diagnostics

SmartLine transmitters all offer digitally accessible diagnostics which aid in providing advanced warning of possible failure events minimizing unplanned shutdowns, providing **lower overall operational costs**

System Integration

- SmartLine communications protocols all meet the most current published standards for HART/DE/Fieldbus.
- Integration with Honeywell's Experion PKS offers the following unique advantages.
 - Tamper reporting
 - FDM Plant Area Views with Health summaries
 - All ST 700 units are Experion tested to provide the highest level of compatibility assurance

Configuration Tools

External Three Button Configuration Option

Suitable for all electrical and environmental requirements, SmartLine offers the ability to configure the transmitter and display via three externally accessible buttons when a display option is selected. Zero/span capabilities are also optionally available via these buttons with or without selection of the display option.

Internal Two Button Configuration Option

The Simple display has two buttons that can be used for Basic configuration such as re ranging, PV Engineering unit setting, Zero/Span settings and Loop testing and calibration functions.

Hand Held Configuration

SmartLine transmitters feature two-way communication and configuration capability between the operator and the transmitter. All Honeywell transmitters are designed and tested for compliance with the offered communication protocols and are designed to operate with any Standards compliant handheld configuration device.

Personal Computer Configuration

Honeywell's SCT 3000 Configuration Toolkit provides an easy way to configure Digitally Enhanced (DE) instruments using a personal computer as the configuration interface. Field Device Manager (FDM) Software and FDM Express are also available for managing HART & Fieldbus device configurations.

Modular Design

To help contain maintenance & inventory costs, all ST 700 transmitters are modular in design supporting the user's ability to replace meter bodies, add indicators or change electronic modules without affecting overall performance or approval body certifications. Each meter body is uniquely characterized to provide in-tolerance performance over a wide range of application variations in temperature and pressure and due to the Honeywell advanced interface, electronic modules may be swapped with any electronics module without losing in-tolerance performance characteristics.

Modular Features

- Meter body replacement
- Exchange/replace electronics/comms modules*
- Add or remove integral indicator*
- Add or remove lightning protection (terminal connection)*

* Field replaceable in all electrical environments (including IS) except flameproof without violating agency approvals.

With no performance effects, Honeywell's unique modularity results in **lower inventory needs and lower overall operating costs.**

Performance Specifications

Reference Accuracy (conformance to +/-3 Sigma)

Table 1

Model	URL	LRL	Min Span	Maximum Turndown Ratio	Reference Accuracy ^{1,2} (% Span)
STR73D	100 psi (7.0 bar)	-100 psi (-7.0bar)	0.9 psi (0.062bar)	111:1	0.075
STR74G	500 psi (35 bar)	-14.7 psi (-1.0 bar)	5 psi (0.035 bar)	100:1	0.075

Table 2

			Accuracy ^{1,2} (% of Span)				Combined Zero & Span Temperature Effect (% Span / 28°C (50°F))		
	Model	URL	Reference Turndown	A	B	C (see URL units)	D	E	F
Standard Accuracy	STR73D	100 psi (7.0 bar)	27.7:1	0.025	0.050	3.61 (0.25)	0.275	1.200	7.2 (0.50)
	STR74G	500 psig (35 bar)	25:1	0.005	0.060	25 (1.4)	-	-	-
			Turn Down Effect				Temp Effect		Static Effect
			$\pm [A + B] \text{ if Span} \geq C$ $\pm \left[A + B \left(\frac{C}{\text{Span}} \right) \right] \text{ if Span} < C$				$\pm \left[D + E \left(\frac{F}{\text{Span}} \right) \right]$ $\pm \left[A + B \left(\frac{F}{\text{Span}} \right) \right] \text{ if Span} < F$		

Accuracy at Specified Span, Temperature and Static Pressure: (conformance to +/-3 Sigma)

Total Performance (% of Span):

$$\text{Total Performance} = \pm \sqrt{(\text{Accuracy})^2 + (\text{Temp Effect})^2}$$

Total Performance Examples (for comparison): (standard accuracy 5:1 Turndown, up to 50 °F (28°C) shift)

STR73D @ 20 psi: 1.477% of span

Typical Calibration Frequency:

Calibration verification is recommended every four (4) years

Notes:

1. Terminal Based Accuracy – Includes combined effects of linearity, hysteresis, and repeatability. Analog output adds 0.005% of span.
2. For zero based spans and reference conditions of 25°C (77°F), 0 psi static pressure for DP, >= 0 psia for GP, 10 to 55% R.H, and 316Stainless Steel barrier diaphragms
3. Specification applies to transmitter with 2 balanced remote seals. Apply a factor of 1.5 for temperature effect of capillary lengths greater than 10 feet.

Operating Conditions – All Models

Parameter	Reference Condition (at zero static)		Rated Condition		Operative Limits		Transportation and Storage							
	°C	°F	°C	°F	°C	°F	°C	°F						
Ambient Temperature ¹	25±1	77±2	-	-	-	-	-55 to 90	-67 to 194						
Humidity %RH	10 to 55		0 to 100		0 to 100		0 to 100							
Vacuum Region, Minimum Pressure mmHg absolute	Atmospheric (See Figure 4 for vacuum limitation)													
Supply Voltage, Current, and Load Resistance	10.8 to 42.4 Vdc at terminals (IS versions limited to 30 Vdc) 0 to 1,440 ohms (as shown in Figure 2)													
Maximum Allowable Working Pressure (MAWP) ⁴ (ST 700 products are rated to Maximum Allowable Working Pressure. MAWP depends on Approval Agency and transmitter materials of construction.)	MAWP is minimum of Body Rating or Seal Rating (See Model Selection Guide for Seal MAWP) <table><tr><td>Body</td><td>MAWP</td></tr><tr><td>STR73D</td><td>750 psig (51.7 bar) Bolted Process Heads</td></tr><tr><td>STR74G</td><td>500 psig (35 bar)</td></tr></table>								Body	MAWP	STR73D	750 psig (51.7 bar) Bolted Process Heads	STR74G	500 psig (35 bar)
Body	MAWP													
STR73D	750 psig (51.7 bar) Bolted Process Heads													
STR74G	500 psig (35 bar)													

¹ Ambient Temperature Limit is a function of Process Interface Temperature. (See Figures 3 & 4)

LCD Display operating temperature -20°C to +70°C . Storage temperature -30°C to 80°C

⁴ Consult factory for MAWP of ST 700 transmitters with CRN approval.

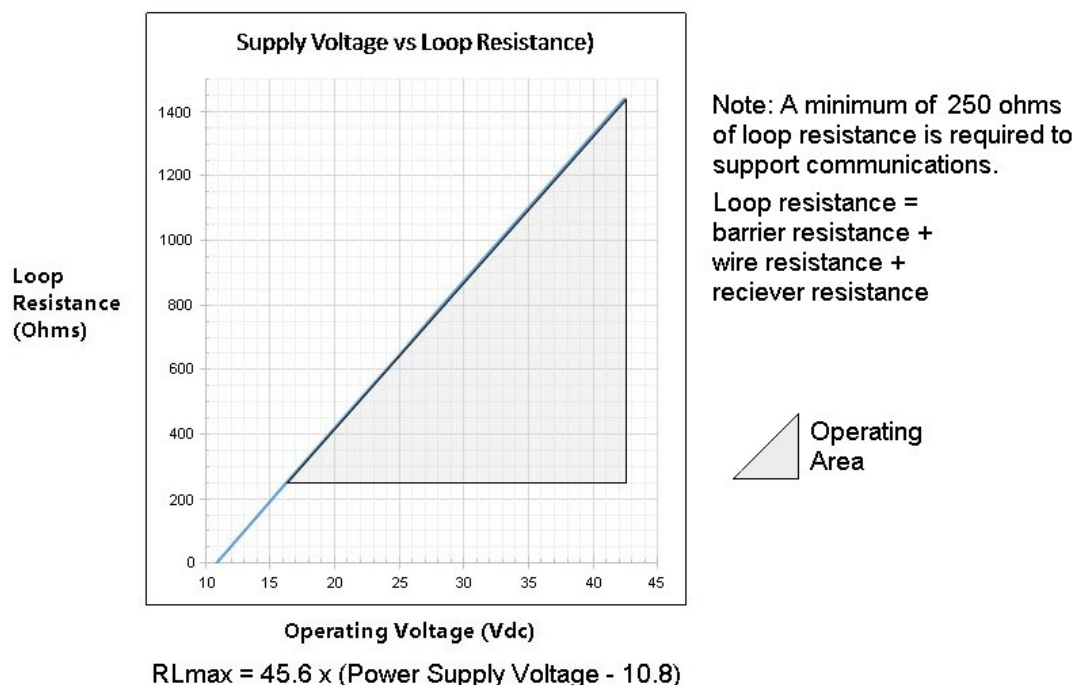


Figure 2- Supply voltage and loop resistance

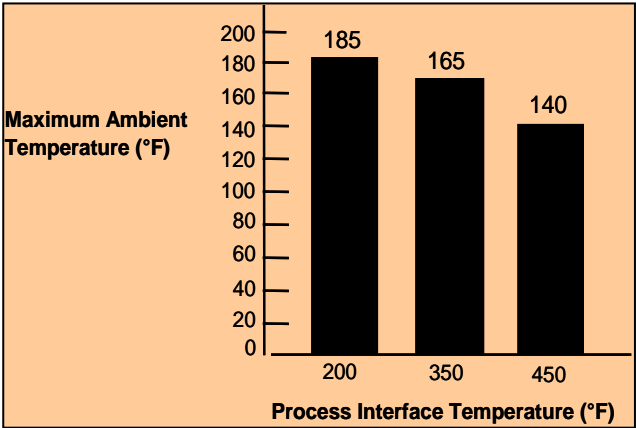


Figure 3- Ambient temperature Limits

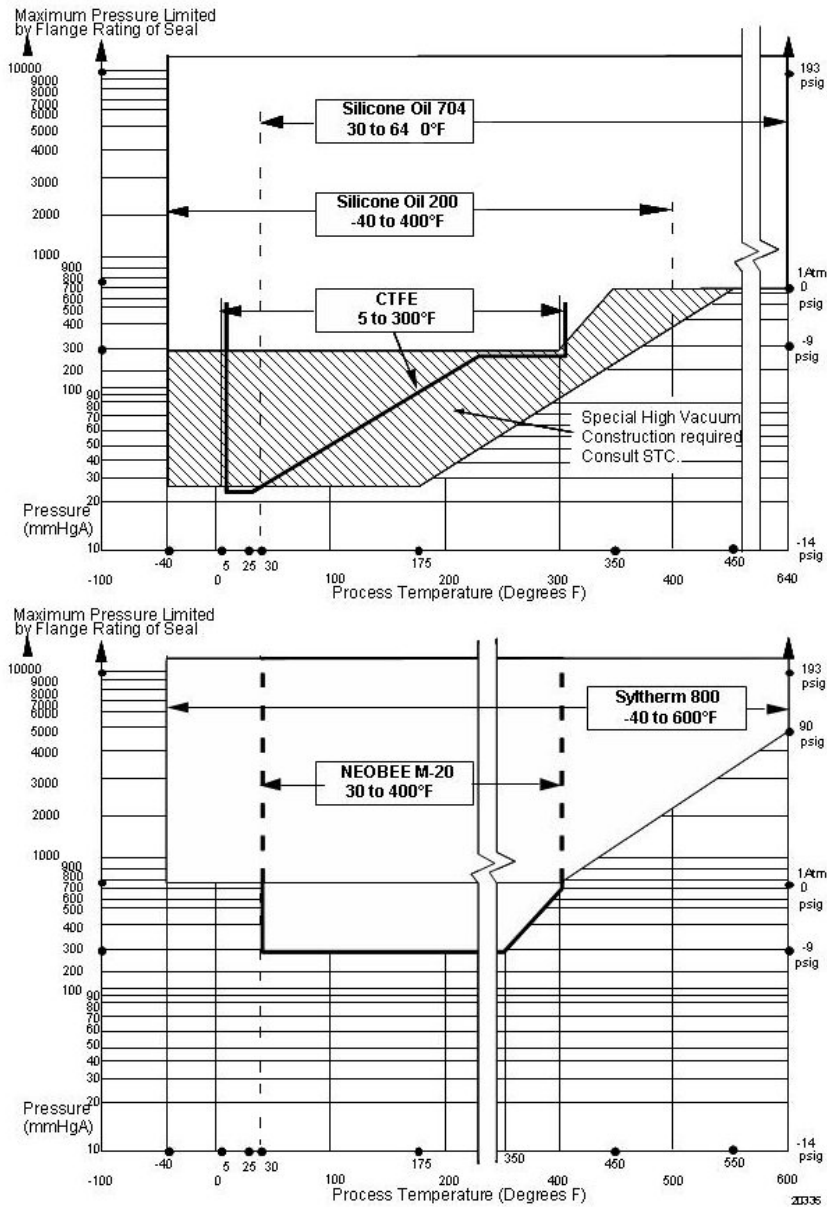


Figure 4 - STR700 Remote Seals operable limits for pressure vs. temperature

Minimum recommended span for STR73D Transmitter with two Seals


Diaphragm Size (Inch)	Capillary Length (Feet)						Maximum Capillary Length (Feet)
	5	10	15	20	25	35	
1.9	15 psi	20 psi	25 psi	-	-	-	15
2.4	5.4 psi	7.2 psi	9.0 psi	10.8 psi	12.6 psi	14.4 psi	35
2.9	1.8 psi	2.7 psi	3.6 psi	4.5 psi	5.4 psi	7.2 psi	35
3.5	0.9 psi	0.9 psi	0.9 psi	1.0 psi	1.2 psi	1.4 psi	35
4.1	0.9 psi	0.9 psi	0.9 psi	0.9 psi	0.9 psi	1.1 psi	35

Minimum recommended span for STR74G and STR73D Transmitter with one Remote Seal

Diaphragm Size (Inch)	Direct Mount	Capillary Length (Feet)						Maximum Capillary Length (Feet)
		5	10	15	20	25	35	
1.9	25 psi	30 psi	40 psi	50 psi	-	-	-	15
2.4	10 psi	15 psi	20 psi	25 psi	30 psi	35 psi	50 psi	35
2.9	8 psi	9 psi	10 psi	11 psi	12 psi	13 psi	15 psi	35
3.5	2 psi	2 psi	3 psi	4 psi	5 psi	6 psi	8 psi	35
4.1	0.9 psi	0.9 psi	1 psi	2 psi	3 psi	3.5 psi	5 psi	35

Note: The minimum span is the higher of the higher of the value from the table above or the value defined under the Performance Conditions for the range transmitter.

Figure 5– Typical Maximum capillary length and diaphragm size chart


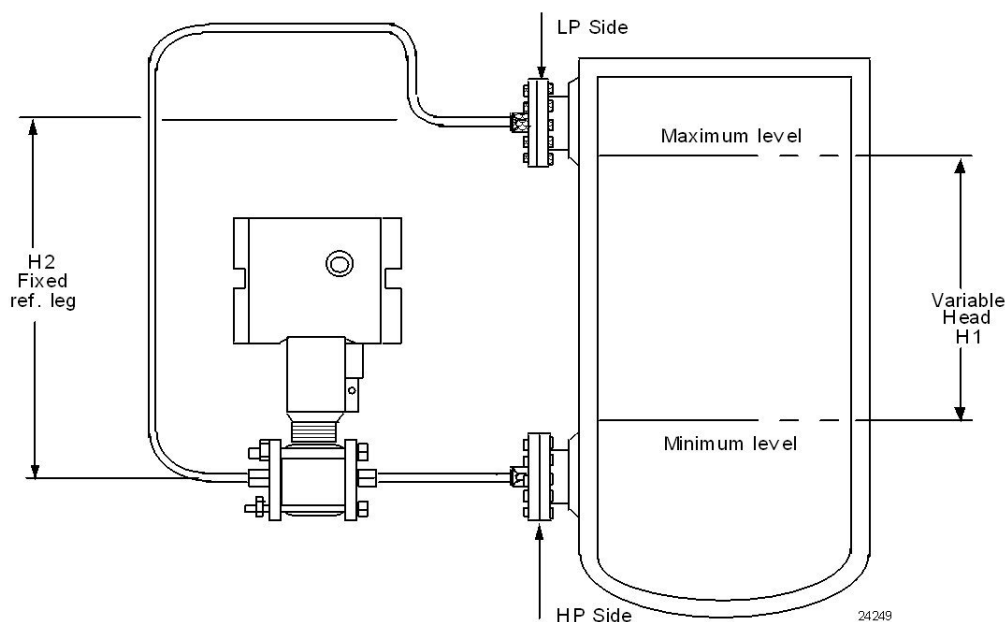


NOTE: Lower flange seal should not be mounted over 22 feet below or above the transmitter for silicone fill fluid (11 feet for CTFE fill fluid) with tank at one atmosphere. The combination of tank vacuum and high pressure capillary head effect should not exceed 9 psi vacuum (300 mmHg absolute).

Consult Honeywell for installation of STR73D.

Figure 6 - STR700 transmitter with remote diaphragm seals shown mounted on a tank

Reference Dimensions Horizontal Mounting

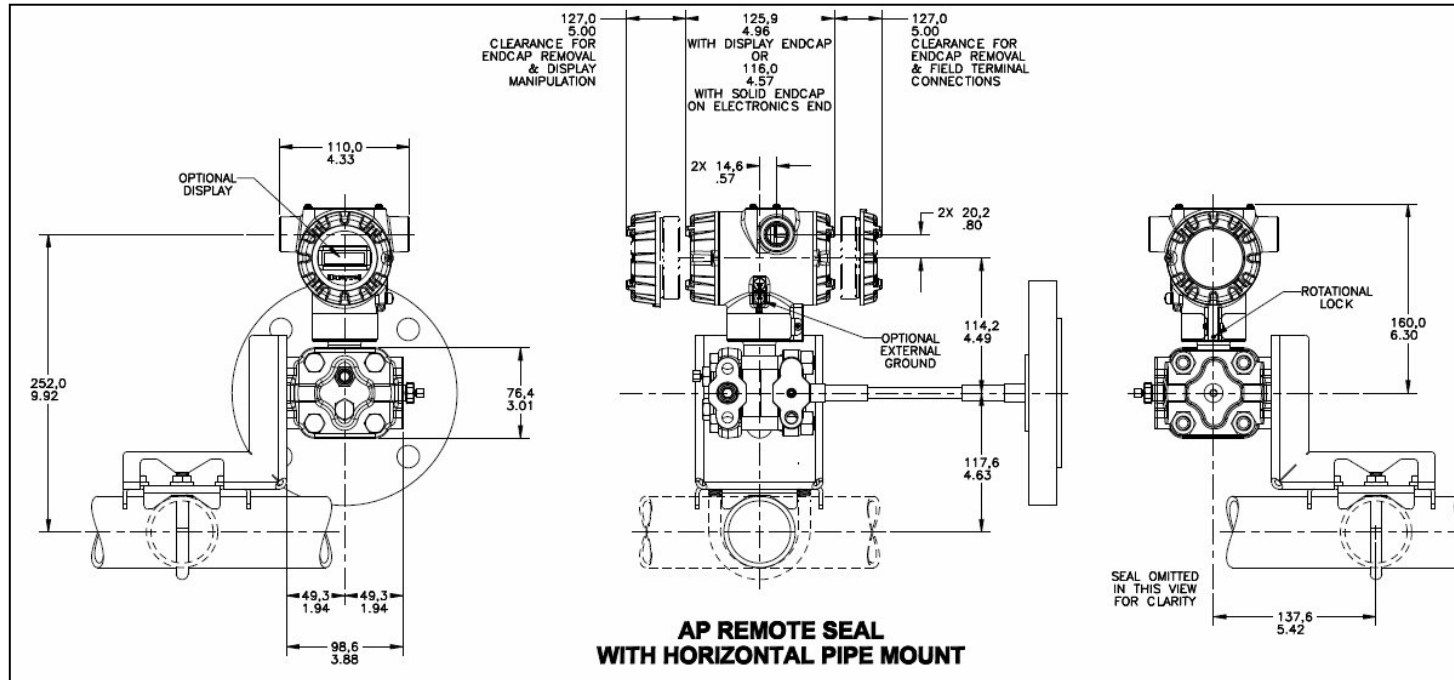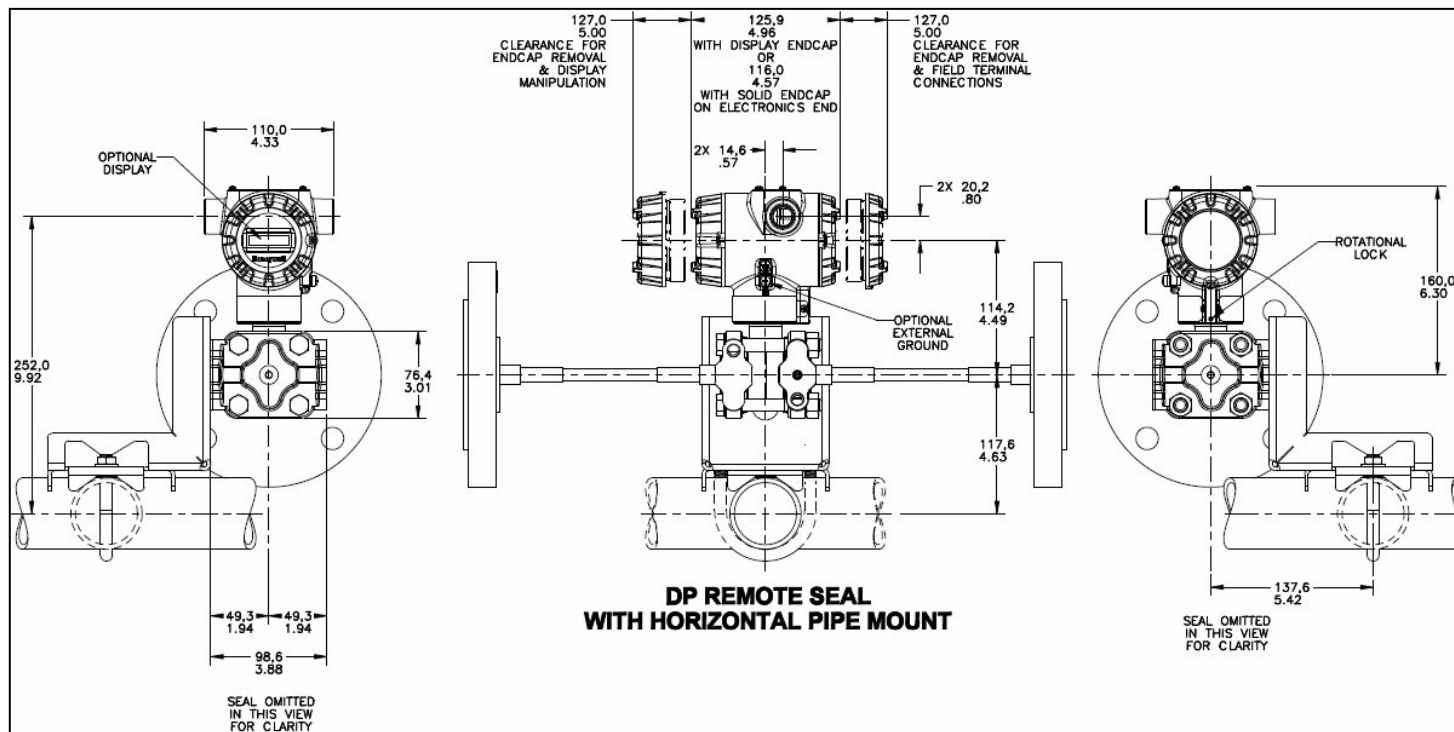

Reference Dimensions Horizontal Mounting (cont'd)


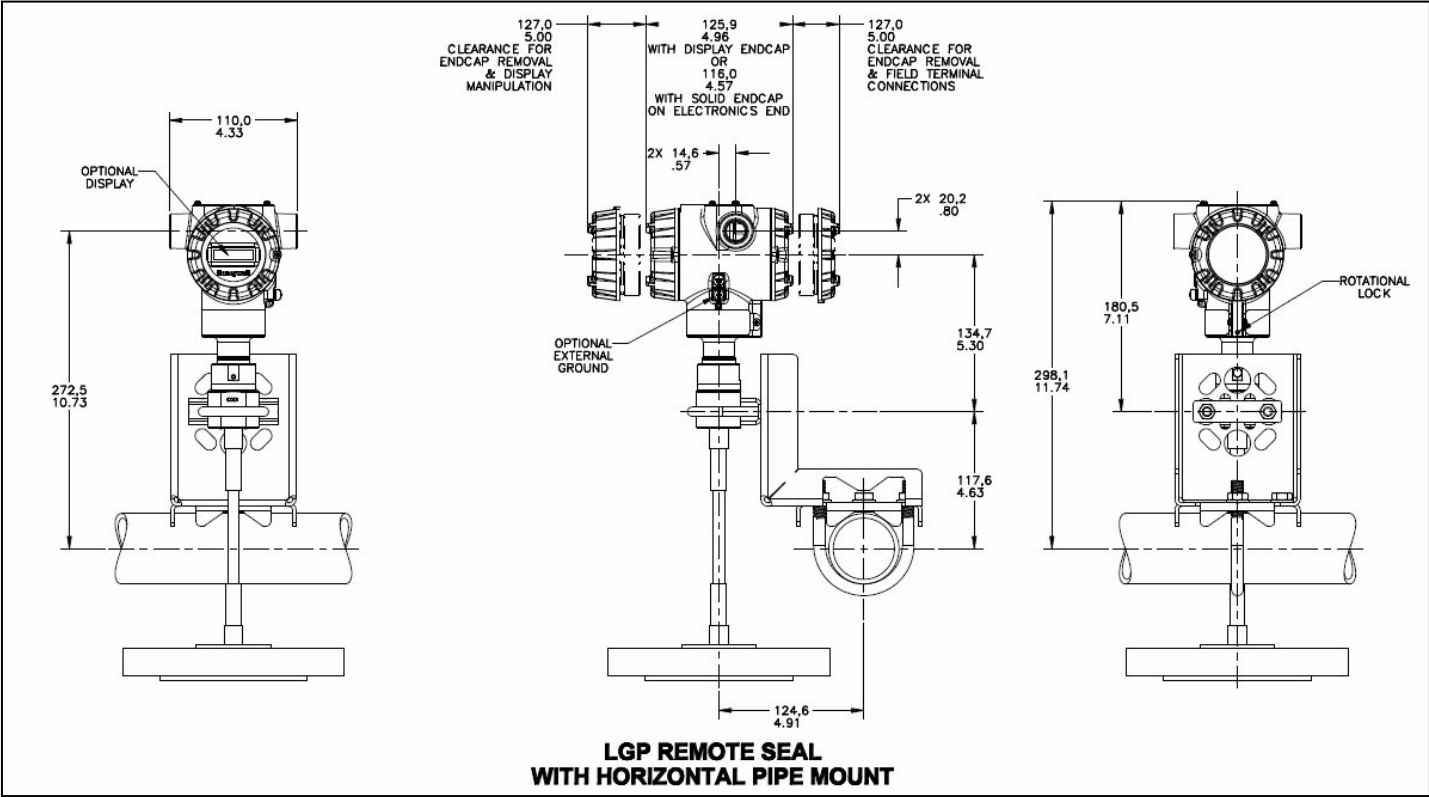


Figure 7 — Approximate horizontal mounting dimensions for Remote Seal Transmitter

Reference Dimensions Vertical Mounting

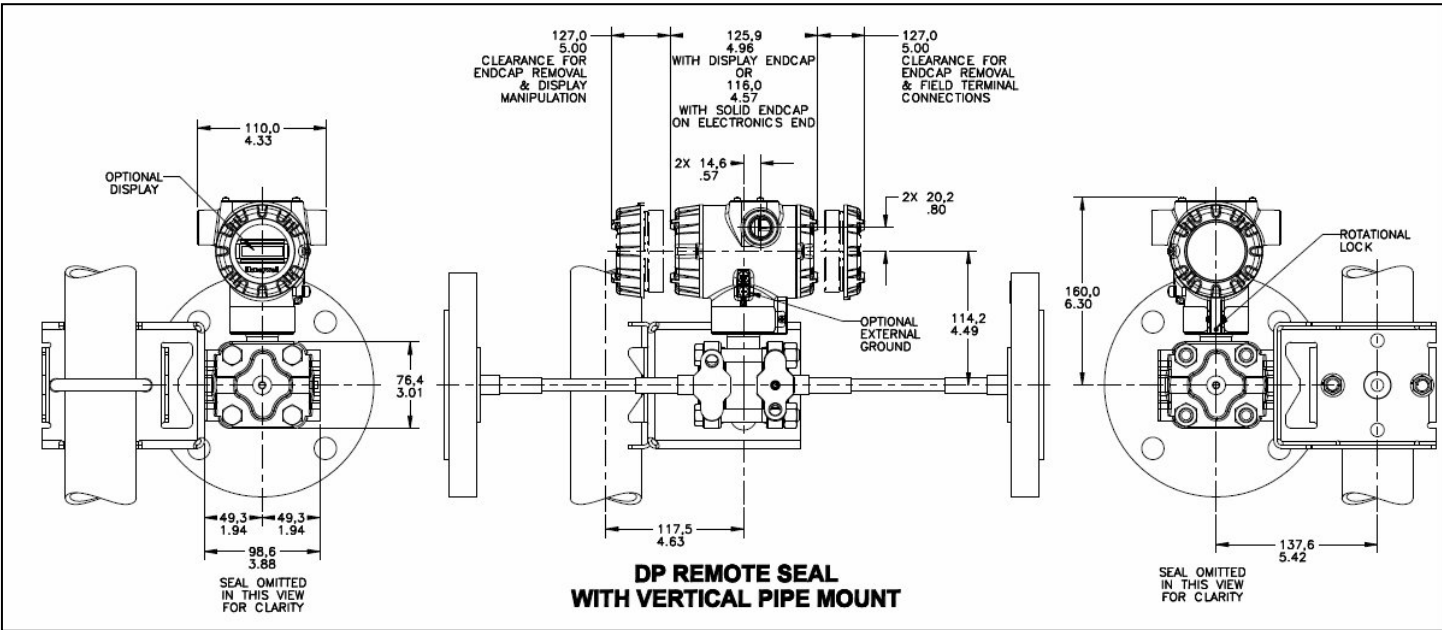

Reference Dimensions Vertical Mounting (cont'd)



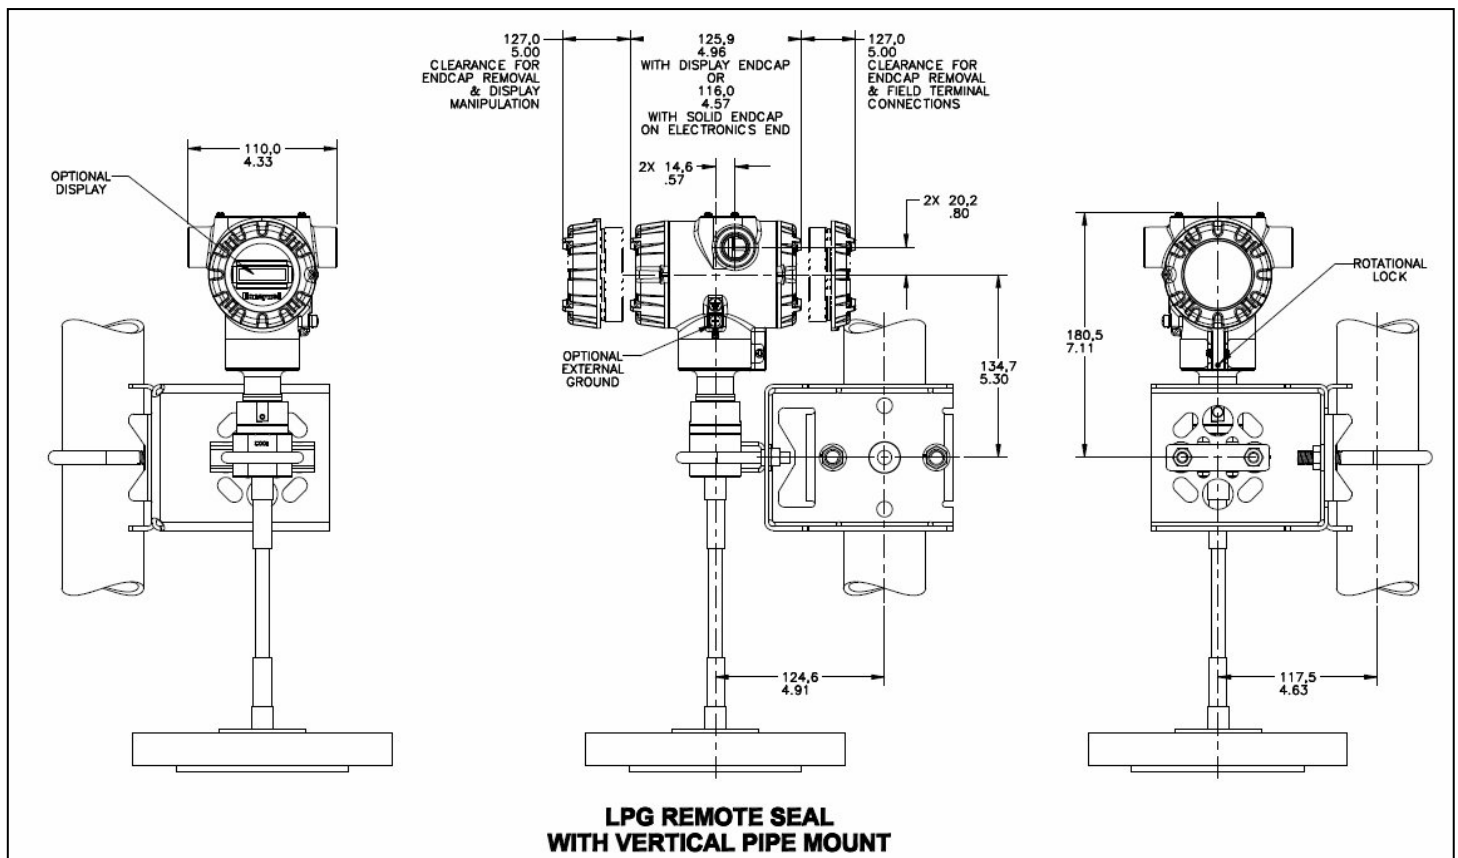


Figure 8 — Approximate vertical mounting dimensions for Remote Seal Transmitter

Reference Dimensions (cont'd)


Flush Flanged Seal Dimensions

Type	ANSI/DIN Rating	Flange Material	Wetted Materials		Construction See figure	↔	
			Diaphragm	Body		A	B
Flush Flanged Seal	3" Class 150#	CS	SS	SS	D	7.5	1.37
			Hastelloy C	SS	C		
			Hastelloy C	Hastelloy C	D		
			Monel	Monel	D		
		SS	Tantalum	SS	C	7.50	0.94
			SS	N/A	B		1.37
			Hastelloy C	SS	A		
			Hastelloy C	Hastelloy C	D		
	3" Class 300#	CS	SS	SS	D	8.25	1.56
			Hastelloy C	SS	C		
			Hastelloy C	Hastelloy C	D		
			Monel	Monel	D		
		SS	Tantalum	SS	C	8.25	1.12
			SS	N/A	B		1.56
			Hastelloy C	SS	A		
			Hastelloy C	Hastelloy C	D		
	3" Class 600#	CS	SS	SS	D	8.25	1.75
			Hastelloy C	SS	C		
			Hastelloy C	Hastelloy C	D		
			Monel	Monel	D		
		SS	Tantalum	SS	C	8.25	1.5
			SS	N/A	B		1.75
			Hastelloy C	SS	A		
			Hastelloy C	Hastelloy C	D		
	DN80-PN40	CS	SS	SS	D	7.87	1.32
			Hastelloy C	SS	C		
			Hastelloy C	Hastelloy C	D		
			Monel	Monel	D		
		SS	Tantalum	SS	C	7.87	0.94
			SS	N/A	B		1.32
			Hastelloy C	SS	A		
			Hastelloy C	Hastelloy C	D		

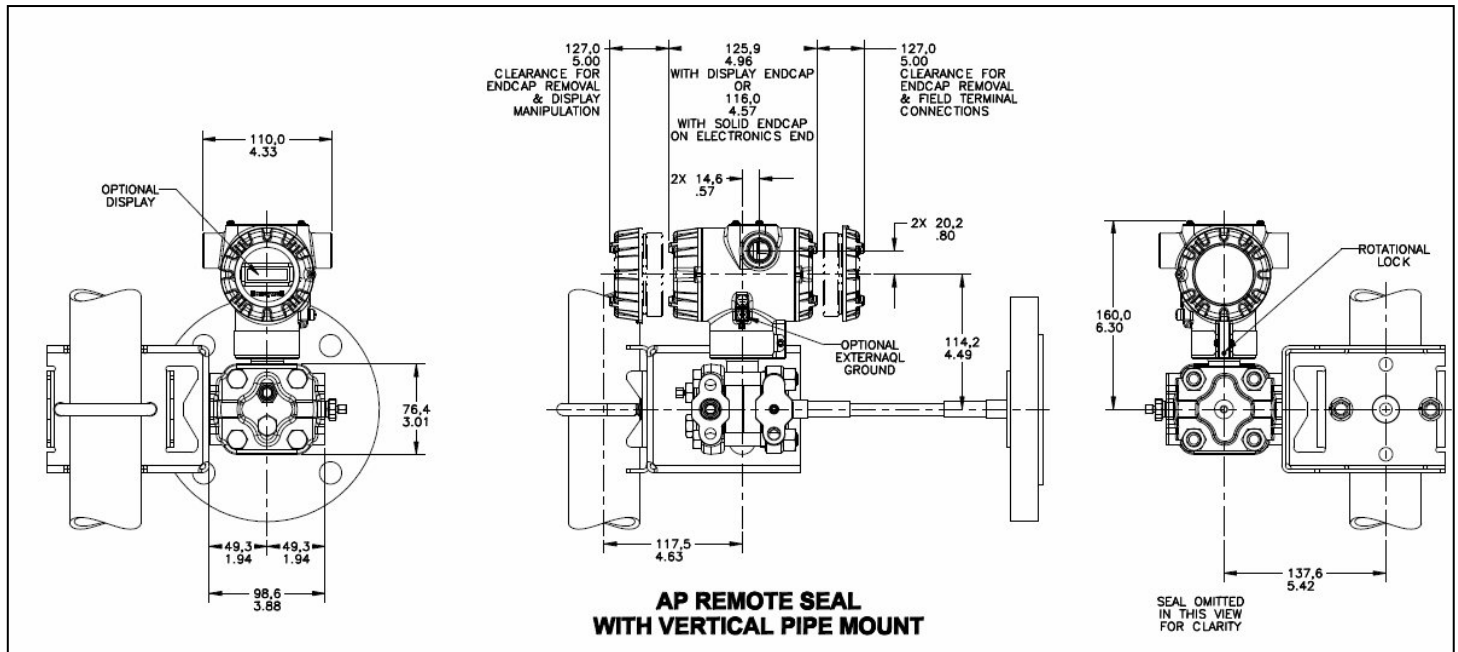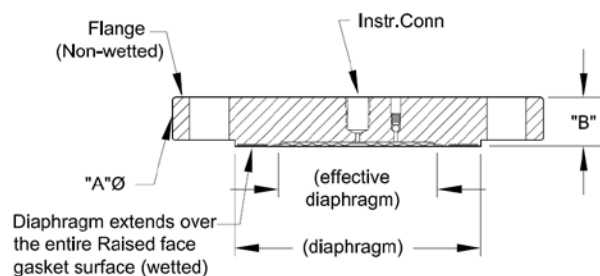


Configuration "HS"

Figure A

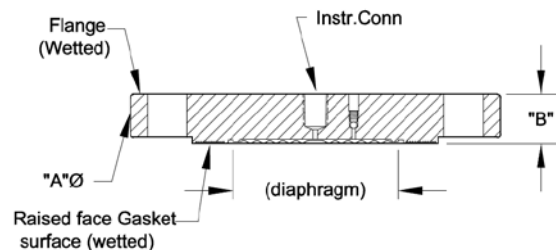


Configuration "HT"

Figure B

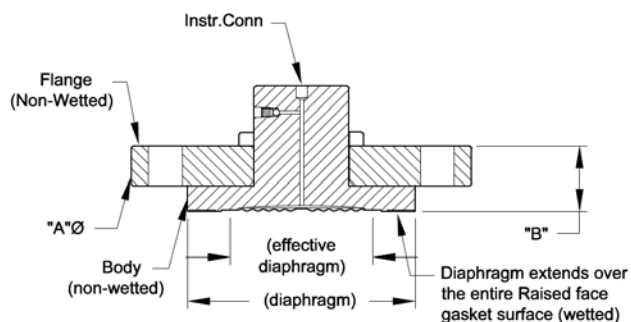

Configuration "IS"

Figure C

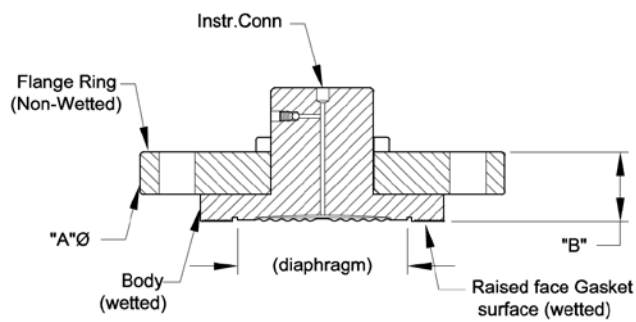

Configuration "IT"

Figure D


Figure 9 - Seal Dimensions (Flush Flanged)

Reference Dimensions (cont'd)


Flush Flanged Seal with Lower

Type	ANSI/DIN Rating	Size	Dimension	2.4" Diaph. Dia. (in.)	2.9" Diaph. Dia. (in.)	4.1" Diaph. Dia. (in.)
Flush Flanged Seal with Lower	Class 150#	1/2"	A	3.50	4.00	5.25
			B0	1.72	1.72	1.84
			B1	1.72	1.72	1.84
			B2	2.22	2.22	2.34
		1"	A	4.25	4.00	5.25
			B0	1.12	1.72	1.84
			B1	1.62	1.72	1.84
			B2	1.98	1.72	2.34
		1-1/2"	A	5.00	5.00	5.25
			B0	2.50	2.50	1.78
			B1	3.00	3.00	2.12
			B2	3.50	3.40	2.12
		2"	A	6.00	6.00	6.00
			B0	2.50	2.50	2.12
			B1	3.00	3.00	2.12
			B2	3.50	3.40	2.12
		3"	A	7.50	7.50	7.50
			B0	2.58	2.88	2.80
			B1	2.88	2.88	3.00
			B2	3.50	3.40	3.40
	Class 300#	1"	A	4.88	4.00	5.25
			B0	2.50	1.72	1.88
			B1	3.00	1.72	2.12
			B2	3.50	2.22	2.12
		1-1/2"	A	6.12	6.12	5.25
			B0	2.50	2.50	2.12
			B1	3.00	3.00	2.12
			B2	3.50	3.40	2.12
		2"	A	6.50	6.50	6.50
			B0	2.50	2.50	2.70
			B1	3.00	3.00	3.00
			B2	3.50	3.40	3.50
		3"	A	8.25	8.25	8.25
			B0	3.48	3.48	3.20
			B1	3.48	3.48	3.60
			B2	4.10	4.00	4.00
	Class 600#	1"	A	4.88	4.50	5.25
			B0	2.50	2.15	2.28
			B1	3.00	2.15	2.28
			B2	3.50	2.40	2.50
		1-1/2"	A	6.12	6.12	5.25
			B0	2.50	1.53	2.50
			B1	3.00	2.09	3.00
			B2	3.50	2.49	3.50
		2"	A	6.50	6.50	6.50
			B0	3.10	3.10	3.30
			B1	3.60	3.60	3.60
			B2	4.10	4.00	4.10
		3"	A	8.25	8.25	8.25
			B0	3.48	3.48	3.20
			B1	3.48	3.48	3.60
			B2	4.10	4.00	4.00

B0 Without Flush
 B1 B Dimension with 1/4 NPT Flushing Connection
 B2 B dimension with 1/2 NPT Flushing Connection

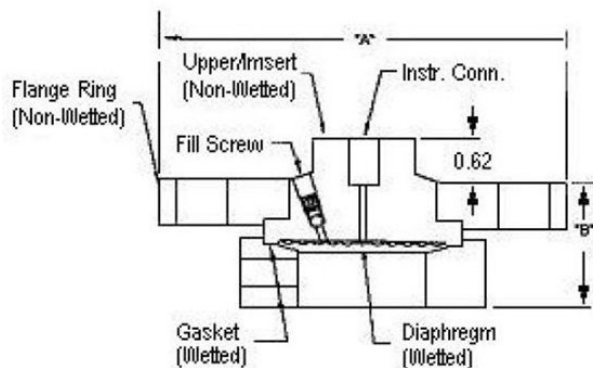

Flush Flanged Seal with Lower

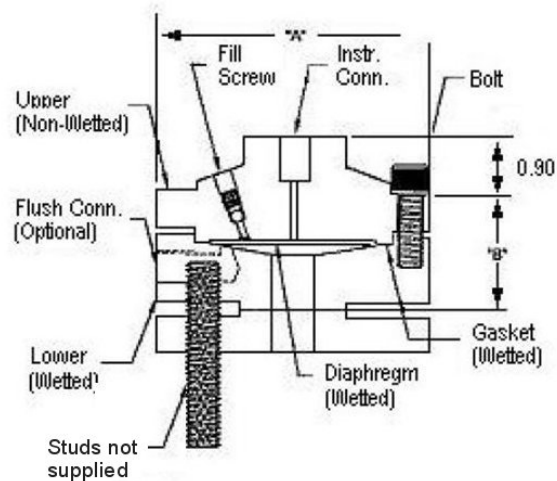

Flush Flanged Seal with Lower

Note: 0.90 dimension is 0.70 for 4.1" Dia Diaphragm

Figure 10- Seal Dimension (Flush Flanged)

Reference Dimensions (cont'd)

Flanged Seal with Extended Diaphragm

Type	ANSI/DIN Rating	Dimension	2.8" Diaphragm Dia. (in.)	3.5" Diaphragm Dia. (in.)
Flanged Seal with Extended Diaphragm	3" Class 150#	A	7.50	-
		B	0.94	-
		C	2.80	-
	3" Class 300#	A	8.25	-
		B	1.12	-
		C	2.80	-
	DIN DN80-PN40	A	7.87	-
		B	0.94	-
		C	2.80	-
	4" Class 150#	A	-	9.00
		B	-	0.94
		C	-	3.70

Designed to meet with schedule 40 pipe

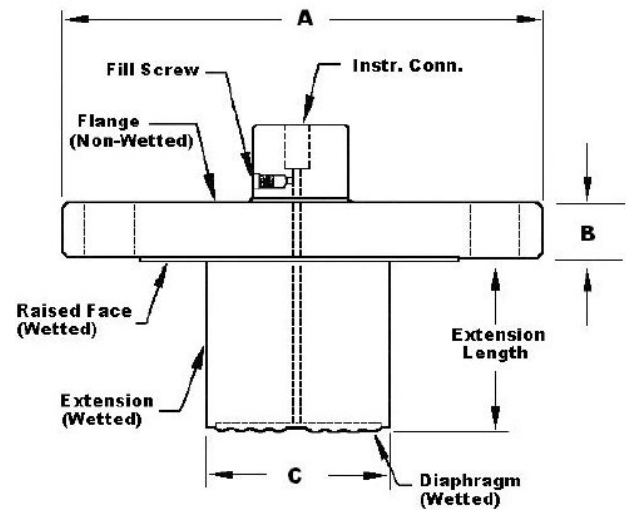


Figure 11 — Seal Dimensions (Extended Diaphragms)

Pancake Seal

Type	ANSI/DIN	Dimension	3.5" Diaph. (in.)
Pancake Seal	Class 150#, 300#, 600# DN80-PN40	A	5.00
		B	1.08

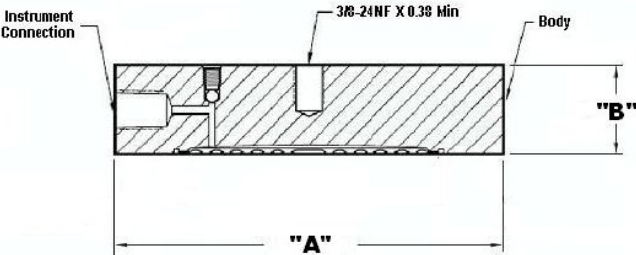


Figure 12 — Seal Dimensions (Pancake)

Chemical Tee “Taylor Wedge” Seal

Type	Size	Dimension	3.5" Diaph. (in.)
Chemical Tee “Taylor Wedge” Seal	750 psi	A	5.00
		B	0.50

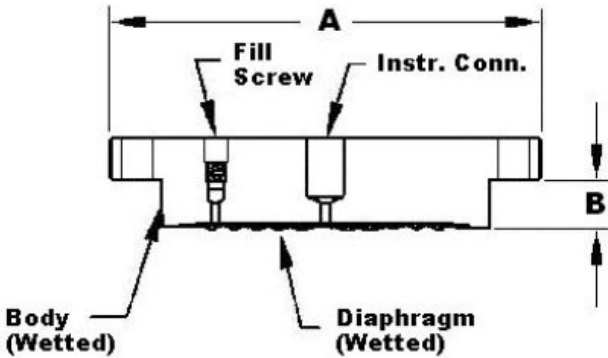


Figure 13 — Seal Dimensions (Chemical TEE “Taylor Wedge” Seals)

Seal with Threaded Process Connection

Type	Size	Dimension	2.4" Diaphragm Dia. (in.)	2.9" Diaphragm Dia. (in.)	4.1" Diaphragm Dia. (in.)
Threaded Process Conn. Seal	1/4" or 1/2"	A	3.50	4.00	5.25
		B0	1.66	1.66	1.79
		B1	1.66	1.66	1.79
		B2	2.18	2.18	2.14
	3/4" or 1"	A	3.50	4.00	5.25
		B0	1.66	1.66	1.79
		B1	1.66	1.66	1.79
		B2	8.25	2.18	2.14

B0 Without Flush

B1 B Dimension with 1/4 NPT Flushing Connection

B2 B dimension with 1/2 NPT Flushing Connection

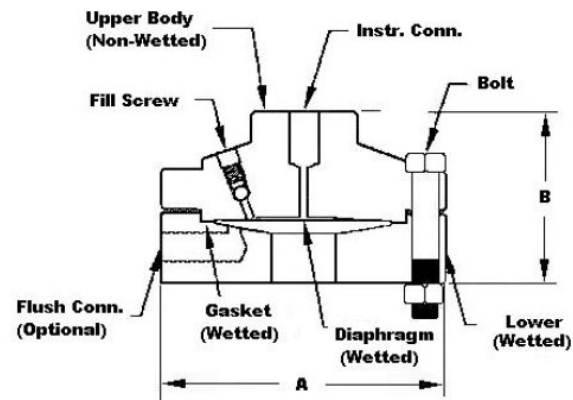


Figure 14— Seal Dimensions (Threaded Process Connection Seals)

Sanitary Seal

Type	Size	Dimension	1.9" Diaphragm Dia. (in.)	2.4" Diaphragm Dia. (in.)	2.9" Diaphragm Dia. (in.)	4.1" Diaphragm Dia. (in.)
Sanitary Seal	2"	A	2.50	-	-	-
		B	1.42	-	-	-
	2- 1/2"	A	-	3.00	-	-
		B	-	1.28	-	-
	3"	A	-	-	3.57	-
		B	-	-	1.38	-
	4"	A	-	-	-	4.68
		B	-	-	-	1.60

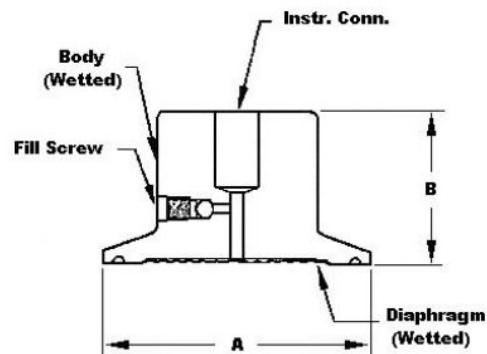


Figure 15— Seal Dimensions (Sanitary Seals)

Saddle Seal

Type	Size	Dimension	2.4" Diaph. (in.)
Saddle Seal	3"	A	3.50
		B	2.90
	4" or larger	A	3.50
		B	3.04

Note: Specify 6 or 8 bolt pattern

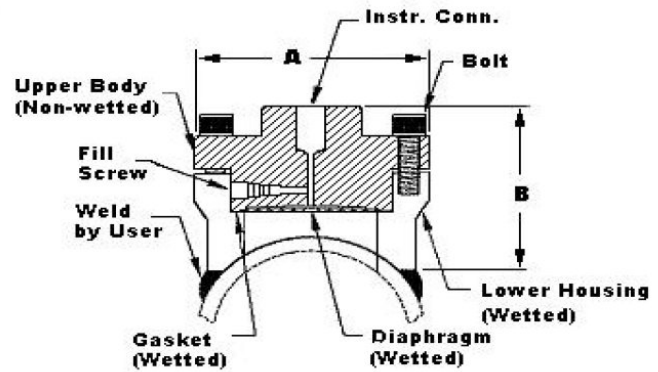


Figure 16— Seal Dimensions (3" Saddle Seal)

Type	Size	Dimension	2.4" Diaph. (in.)
Saddle Seal	3"	A	3.50
		B	2.90
	4" or larger	A	3.50
		B	3.04

Note: Specify 6 or 8 bolt pattern

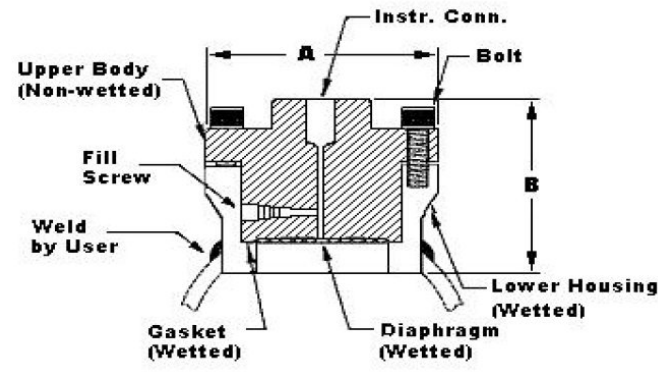


Figure 17— Seal Dimensions (4" Saddle Seal)

Calibration Ring

Type	Size	Rating	Dimension	1/4 NPT	1/2 NPT
Calibration Ring	3"	150# / 800#	A	5.00	5.00
			B	1.00	1.50
			C	3.00	3.00

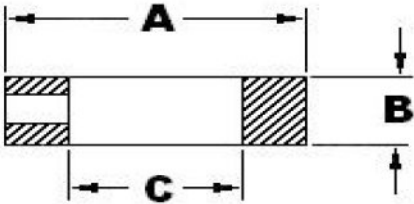


Figure 18— Calibration Ring

Communications Protocols & Diagnostics

HART Protocol

Version:

HART 7

Power Supply

Voltage: 10.8 to 42.4Vdc at terminals

Load: Maximum 1440 ohms. See Figure 2.

Minimum Load: 0 ohms. (For handheld communications a minimum load of 250 ohms is required)

Foundation Fieldbus (FF)

Power Supply Requirements

Voltage: 9.0 to 32.0Vdc at terminals

Steady State Current: 17.6mAdc

Software Download Current: 27.4mAdc

Available Function Blocks

Block Type	Qty	Execution Time
Resource	1	n/a
Transducer	1	n/a
Diagnostic	1	n/a
Analog Input	1*	30 ms
PID w/Autotune	1	45 ms
Integrator	1	30 ms
Signal Char (SC)	1	30 ms
LCD Display	1	n/a
Flow Block	1	30 ms
Input Selector	1	30 ms
Arithmetic	1	30 ms

* AI block may have two (2) additional instantiations.

All available function blocks adhere to FOUNDATION Fieldbus standards. PID blocks support ideal & robust PID algorithms with full implementation of Auto-tuning.

Link Active Scheduler

Transmitters can perform as a backup Link Active Scheduler and take over when the host is disconnected. Acting as a LAS, the device ensures scheduled data transfers typically used for the regular, cyclic transfer of control loop data between devices on the Fieldbus.

Number of Devices/Segment

Entity IS model: 6 devices/segment

Schedule Entries

18 maximum schedule entries

Number of VCR's: 24 max

Compliance Testing: Tested according to ITC 6.0.1

Software Download

Utilizes Class-3 of the Common Software Download procedure as per FF-883 which allows the field devices of any manufacturer to receive software upgrades from any host.

Honeywell Digitally Enhanced (DE)

DE is a Honeywell proprietary protocol which provides digital communications between Honeywell DE enabled field devices and Hosts.

Power Supply

Voltage: 10.8 to 42.4Vdc at terminals

Load: Maximum 1440 ohms See **Figure 2**.

Standard Diagnostics

ST 700 top level diagnostics are reported as either critical or non-critical and readable via the DD/DTM tools or integral display as shown below.

Critical Diagnostics

HART DD/DTM Tools	Basic Display	Simple Display
Electronic Module DAC Failure	Electronics module fault	Fault Comm EI
Meter Body NVM Corrupt	Meter Body fault	Fault Mtrbody
Config. Data Corrupt	Electronics module fault	Fault Comm EI
Electronic Module Diag Failure	Electronics module fault	Fault Comm EI
Meter Body Critical Failure	Meter Body fault	Fault Mtrbody
Sensor Comms Timeout	Meter Body Comm fault	Fault Mbd Com

Non-Critical Diagnostics

HART DD/DTM Tools
Display Failure
Electronic Module Comm Failure
Meter Body Excess Correct
Sensor Over Temperature
Fixed Current Mode
PV Out of Range
No Factory Calibration
No DAC Compensation
LRV Set Error – Zero Config. Button
URV Set Error – Zero Config. Button
AO Out of Range
Loop Current Noise
Meter Body Unreliable Comm
Tamper Alarm,
No DAC Calibration
Sensor Supply Voltage Low

Refer to ST 700 manuals for additional level diagnostic information.

Hazardous Areal Certifications:

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
A	FM Approvals™ USA	Explosionproof: Class I, Division 1, Groups A, B, C, D; Dust Ignition Proof: Class II, III, Division 1, Groups E, F, G; T6..T5 Class I, Zone 0/1, AEx db IIC T6..T5 Ga/Gb Class II, Zone 21, AEx tb IIIC T95° Db	All	Note 1	T5: -50 °C to 85°C T6: -50 °C to 65°C
		Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D, E, F, G: T4 Class I, Zone 0, AEx ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2a	-50 °C to 70°C
			Foundation Fieldbus	Note 2b	-50 °C to 70°C
		Nonincendive: Class I, Division 2, Groups A, B, C, D locations, T4 Class I, Zone 2, AEx nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50 °C to 85°C
		Enclosure: Type 4X/ IP66/ IP67	All	All	-
		STANDARDS: FM Class 3600:2011; FM Class 3610: 2010; FM Class 3611: 2004; FM Class 3615: 2006; FM Class 3616: 2011; FM Class 3810: 2005; ANSI/ISA 60079-0: 2013; ANSI/UL 60079-1: 2015; ANSI/UL 60079-11: 2014; ANSI/ISA 60079-15: 2012; ANSI/UL 60079-26: 2017; ANSI/UL 60079-31: 2015; ANSI/NEMA 250: 2003; ANSI/ IEC 60529: 2004			
B	Canadian Standards Association (CSA) USA and Canada	Explosion Proof: Class I, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1, T6..T5 Class I Zone 1 AEx db IIC T6..T5 Ga/Gb Ex db IIC T6..T5 Ga/Gb Zone 22 AEx tb IIIC T95° Db Ex tb IIIC T95° Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Class I, II, III, Division 1, Groups A, B, C, D; Class II, Division 1, Groups E, F, G; Class III, Division 1, T4 Class I Zone 0, AEx ia IIC T4 Ga Class I Zone 2, AEx ic IIC T4 Gc Ex ia IIC T4 Ga Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Nonincendive: Class I, Division 2, Groups A, B, C, D; Class II, Division 2, Groups F, G; Class III, Division 2, T4 Class I Zone 2 AEx nA IIC T4 Gc Ex nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C to 85°C
		Enclosure: Type 4X/ IP66/ IP67	All	All	-

MSG CODE	AGENCY	TYPE OF PROTECTION	COMM. OPTION	ELECTRICAL PARAMETERS	AMBIENT TEMP (Ta)
		STANDARDS: CSA C22.2 No. 0-10; CSA C22.2 No. 94-M91; CSA C22.2 No. 25-1966; CSA C22.2 No. 30-M1986; CSA C22.2 No. 142-M1987; CSA C22.2 No. 157-92; CSA C22.2 No. 213-M1987; CSA-C22.2 No. 60529:05; CSA-C22.2 No. 60079-0:11; CSA-C22.2 No. 60079-1:11; CSA-C22.2 No. 60079-11:11; CSA-C22.2 No. 60079-15:12; CSA-C22.2 No. 60079-31:12; ISA 12.12.01-2010; ISA 60079-0: 2009; ISA 60079-11: 2011; ISA 60079-15: 2009; ISA 60079-26: 2008; ISA-60079-27:2007 (12.02.04)-2006 (R2011); UL 913 Ed. 6; UL 916:1998; ANSI/ISA-12.27.01-2011			
C	ATEX	Flameproof: SIRA 12ATEX2233X II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: SIRA 12ATEX2233X II 1 G Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: SIRA 12ATEX4234X II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: SIRA 12ATEX4234X II 3 G Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) II 3 G Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
		STANDARDS: EN 60079-0: 2012/A11: 2013; EN 60079-1: 2014; EN 60079-7: 2015; EN 60079-11: 2012; EN 60079-26: 2015; EN 60079-31: 2009			
D	IECEX World	Flameproof: IECEx SIR 12.0100X Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: IECEx SIR 12.0100X Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: IECEx SIR 12.0100X Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: IECEx SIR 12.0100X Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
		STANDARDS: IEC 60079-0: 2011; IEC 60079-1: 2014; IEC 60079-7: 2017; IEC 60079-11: 2011; IEC 60079-26: 2014; IEC 60079-31: 2013			

E	SAEx South Africa	Flameproof : Ex d IIC T6...T5 Ga/Gb Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC Ga T4 FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
F	INMETRO Brazil	Flameproof: Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2a	-50°C TO 70°C
			Foundation Fieldbus	Note 2b	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	-
G	NEPSI CHINA	Flameproof: Ex db IIC T6..T5 Ga/Gb Ex tb IIIC T 95°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Increase Safety: II 3 G Ex ec IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ex ic IIC T4 Gc FISCO Field Device (Only for FF Option) Ex ic IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	-

H	KOSHA Korea	Flameproof : Ex d IIC T4, T5, T6 Ex tD A21 IP66/IP67 T95°C...T120 °C	All	Note 1	T4: -50°C TO 85°C T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4	4-20 mA / DE/ HART	Note 2	Ta= -50 °C to 70°C
			Foundation Fieldbus	Note 2	Ta= -50 °C to 70°C
		Enclosure: IP66/ IP67	All	All	-
I	EAC Russia, Belarus and Kazakhstan	Flameproof: Ga/Gb Ex d IIC T6..T5 Ex tb IIIC Db T 85°C	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ga Ex ia IIC T4 X FISCO Field Device (Only for FF Option) Ga Ex ia IIC T4 X	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Zone 2, Non Sparking: 2 Ex nA IIC T4 Gc X	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Zone 2, Intrinsically Safe: Ga Ex ic IIC T4 X FISCO Field Device (Only for FF Option) 2 Ex ic IIC T4 Gc X	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 2	-50°C TO 85°C
		Enclosure : IP 66/67	All	All	
J	CCoE INDIA	Flameproof: Ex d IIC T6..T5 Ga/Gb	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) Ex ia IIC T4 Ga; Ex ic IIC T4 Gc	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Non Sparking Ex nA IIC T4 Gc	4-20 mA / DE/ HART/ Foundation Fieldbus	Note 1	-50°C TO 85°C
		Enclosure: IP66/ IP67	All	All	-
K	UATR UKRAINE	Flameproof: II 1/2 G Ex db IIC T6..T5 Ga/Gb II 2 D Ex tb IIIC T95°C...T120°C Db	All	Note 1	T5: -50°C TO 85°C T6: -50°C TO 65°C
		Intrinsically Safe: II 1 G Ex ia IIC T4 Ga FISCO Field Device (Only for FF Option) II 1 G Ex ia IIC T4 Ga	4-20 mA / DE/ HART	Note 2	-50°C TO 70°C
			Foundation Fieldbus	Note 2	-50°C TO 70°C
		Enclosure: IP66/ IP67	All	All	-

- NACE MRO175, MRO103, ISO15156

Application Data

Liquid Level: Closed Tank

Determine the minimum and maximum pressure differentials to be measured (Figure 16).

$$\begin{aligned} P_{\text{Min}} &= (SG_p \times a) - (SG_f \times d) \\ &= \text{LRV when HP at bottom of tank} \\ &= -\text{URV when LP at bottom of tank} \end{aligned}$$

$$\begin{aligned} P_{\text{Max}} &= (SG_p \times b) - (SG_f \times d) \\ &= \text{URV when HP at bottom of tank} \\ &= -\text{LRV when LP at bottom of tank} \end{aligned}$$

Where:

minimum level at 4mA
maximum level at 20 mA

a = distance between bottom tap and minimum level

b = distance between bottom tap and maximum level

d = distance between taps

SG_f = Specific Gravity of capillary fill fluid (See Page 6 "Material Specifications" for values.)

SG_p = Specific Gravity of process fluid

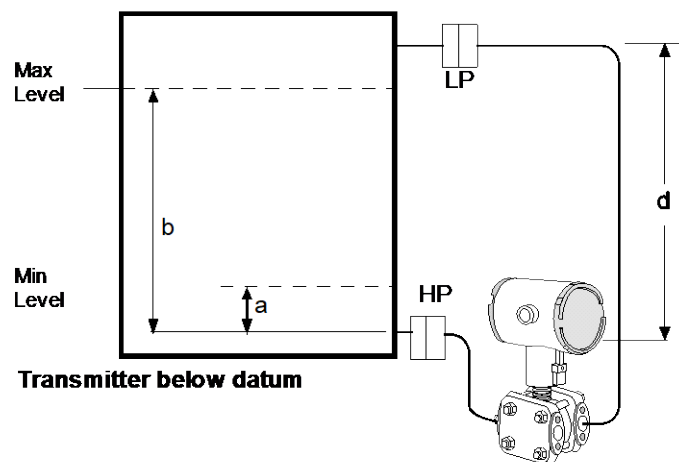
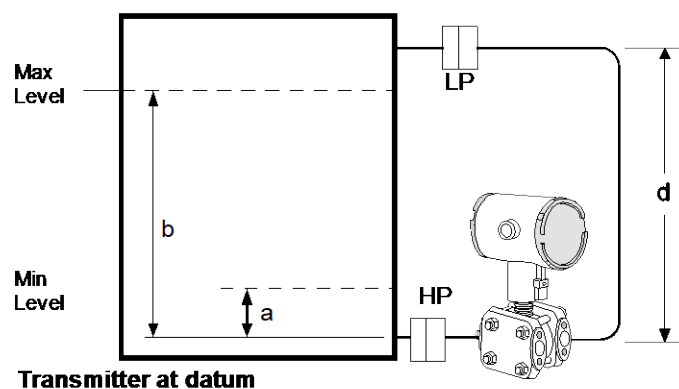
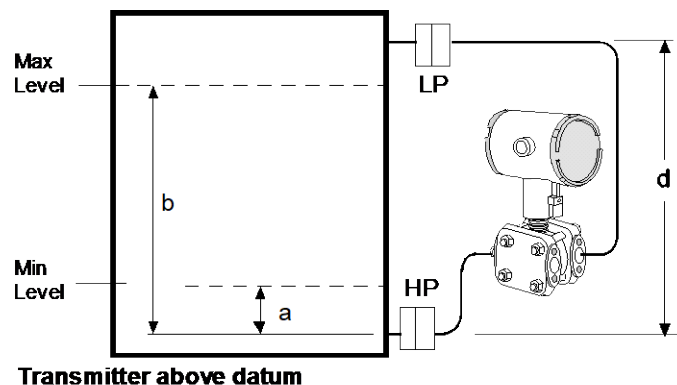


Figure 16—Closed tank liquid level measurement distance 24253

Application Data (Cont'd)

Density or Interface*

Calculate the minimum and maximum pressure differentials to be measured (Figure 19).

$P_{\min} = (SG_{\min} - SG_f) \times (d);$
minimum density, 4mA output

$P_{\max} = (SG_{\max} - SG_f) \times (d);$
maximum density, 20mA output


Where:

d = distance between the taps

SG_{\max} = maximum Specific Gravity

SG_{\min} = minimum Specific Gravity

SG_f = Specific Gravity of capillary fill fluid (See Page 6 "Material Specifications" for values.)

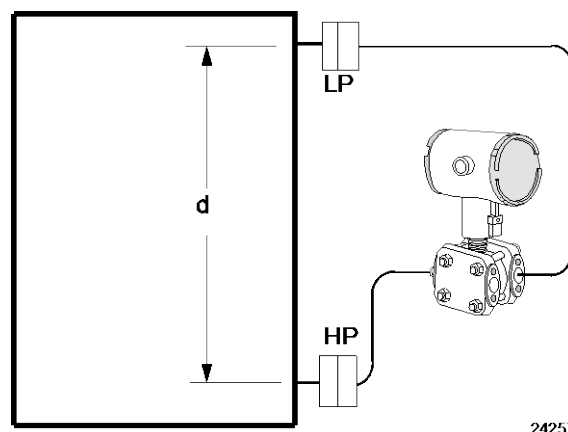

24257

Figure 19- Density, direct acting transmitter configuration

Seal Configurations



Figure 20—Flush Flange Seals

Flush Flange Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" ANSI Class 150, ANSI Class 300 and DIN DN80-PN40 process connections. Flush flange seals can also be provided with Lowers. Lowers are essentially calibration rings, which allow flushing connections if needed.



Figure 22—Pancake Seals

Pancake Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" ANSI Class 150, 300 and 600 process connections.



Figure 21 — Flange Seal with Extended Diaphragm

Flange Seal with Extended Diaphragm can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" ANSI Class 150, ANSI Class 300, DIN DN80-PN40 and DIN DN100-PN40 process connections. 2", 4" and 6" extension lengths are available



Figure 23— Chemical Tee "Taylor" Wedge

Chemical Tee "Taylor" Wedge can be used with differential pressure transmitters and are available with Taylor Wedge 5" O.D. process connection.

Seal Configurations (cont'd)



Figure 24— Seals with Threaded Process Connections

Seals with Threaded Process Connections can be used with differential, gauge and absolute pressure transmitters and are available with ½", ¾" and 1" NPT Female process connections.



Figure 25 — Sanitary Seals

Sanitary Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" Tri-Clover-Tri-Clamp process connections.



Figure 26— Saddle Seals

Saddle Seals can be used with differential, gauge and absolute pressure transmitters and are available with 3" and 4" (6 bolt or 8 bolt designs) process connections.



Figure 27 — Calibration Rings

Calibration Rings are available with Flush Flange Seals and Pancake Seals. Flushing ports (¼" or ½") are available with calibration rings.



Figure 28 — Stainless Steel Armor and PVC Coated Stainless Steel Armor Capillaries

Stainless Steel Armor and PVC Coated Stainless Steel Armor Capillaries are available with Honeywell Remote Seal Solutions.



Figure 29 — 2" Stainless Steel Nipples
2" Stainless Steel Nipples are available for Close-Coupled remote seal solutions



Figure 30 — Welded Meter Body for All-Welded Remote Seal Solution

Welded Meter Body for All-Welded Remote Seal Solution. The welded ST 700 meter body is an important part of an All-Welded Remote Seal Solution, which is commonly used in Vacuum applications.

Model Selection Guide

Model Selection Guides are subject to change and are inserted into the specifications as guidance only.

Model STR700 (DP, GP) Remote Seals

Model Selection Guide
34-ST-16-104 Issue 25


Instructions

- Select the desired Key Number. The arrow to the right marks the selection available.
- Make selections from each Table (I, II and IX) using the column below the proper arrow.
- A (●) denotes unrestricted availability. A letter denotes restricted availability.
- Restrictions follow Table IX.

Key Number	I	II	III	IV	V	VI	VII	VIII	IX
STR7__	-	-	-	-	-	-	-	-	0000

KEY NUMBER	URL	LRL	Max Span	Min Span	Units	Selection	Availability
Measurement	100 (7)	-100 (-7)	100 (7)	0.9 (0.062)	psi (bar)	STR73D	↓
Range Std Accuracy	500 (35)	-14.7 (-1.0)	500 (35)	5 (0.35)	psi (bar)	STR74G	↓

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

TABLE I	Description				Selection			
Meter Body & Capillaries	a. Number of Seals	1 Remote Seal (High Side)			1 _____	•	•	
		2 Remote Seals			2 _____	•		
		1 Remote Seal (Low Side)			3 _____	•		
	b. Primary Fill Fluid (Meter body)	Silicone Oil 200			1 _____	•	•	
		Fluorinated Oil CTFE			2 _____	2	2	
		Silicone Oil 704			3 _____	•	•	
		NEOBEE® M-20 ¹¹			4 _____	•	•	
	c. Construction	Non-Wetted Adapter Head Materials						
	In-Line Gauge	316 SS Bonnet			A _____		•	
		316 SS Bonnet for Close-Couple			B _____		3	
	Dual Head DP	316 SS (bolt-on heads)			C _____	•		
		316 SS for Close-Couple			D _____	3		
		316 SS with all-welded meter body			E _____	4		
	d. Bolts and Nuts for Transmitter Heads	None			0 _____	22	•	
		Carbon Steel Bolts and Nuts			C _____	•		
		316 SS Bolts and Nuts			S _____	•		
		A286 SS (NACE) Bolts and 304 SS (NACE) Nuts			N _____	•		
		B7M (NACE) Bolts and 7M (NACE) Nuts			B _____	•		
	e. Secondary Fill Fluid (capillary & seal)**	No Fill Fluid			0 _____	5	5	
		Silicone Oil 200			1 _____	•	•	
		Fluorinated Oil CTFE			2 _____	•	•	
		Silicone Oil 704			3 _____	•	•	
		Neobee® M20 ¹¹			4 _____	•	•	
		Syltherm® 800 ¹²			5 _____	•	•	
	f. Connection of Remote Seal to Meter Body** 	No Capillary, No Nipple (Specify for VAM Unit Only)				0 _____	5	5
		Capillary Length	5 feet	1.5 m	SS Armor	A _____	•	•
			10 feet	3.0 m		B _____	•	•
15 feet			4.5 m	C _____		•	•	
20 feet			6.1 m	D _____		•	•	
25 feet			7.5 m	E _____		•	•	
35 feet			10.7 m	F _____		•	•	
5 feet			1.5 m	PVC Coated SS Armor	G _____	•	•	
10 feet			3.0 m		H _____	•	•	
15 feet			4.5 m		J _____	•	•	
20 feet			6.1 m		K _____	•	•	
25 feet			7.5 m		L _____	•	•	
35 feet			10.7 m		M _____	•	•	
2 inch long SS nipple close-coupled				2 _____	6	6		
g. Seal Option**			None			0 _____	•	•
			Std Gold Plated Seal Diaph. = 50 µin			1 _____	7	7
			Teflon Coated Seal Diaphragm - only for anti-sticking			4 _____	7	7

STR74G
STR73D

Note: When selecting required seal, you must specify only the 9 selections within the required seal type.

Selection



TABLE II		Description							
Seals	No Seal Attached to Core Transmitter (Specify for VAM Unit Only)					0 0 0 0 0 0 0 0	21	21	
	<div>Seal Type</div> <div></div> <div>Flush Flanged Seal**</div>	Diaphragm Diameter	Flange Size	Flange Pressure Rating ¹		Selection			
		3.5"	3"	ANSI Class 150		AFA _____	•	•	
					ANSI Class 300		AFC _____	•	•
			80mm	DIN DN80-PN40		AFM _____	•	•	
		Wetted Material		Diaphragm	Upper Insert	Selection			
				316L SS	316L SS	___ AA ___	•	•	
			Hastelloy® C-276	316L SS	___ AB ___	•	•		
			Hastelloy® C-276	Hastelloy® C-276	___ AC ___	•	•		
			Monel 400®	Monel 400®	___ AE ___	8	8		
			Tantalum ⁵	316L SS	___ AF ___	8	8		
		Non-Wetted Material (upper)	CS (Nickel Plated)		___ 1 ___	•	•		
			316L SS		___ 2 ___	•	•		
		Seal-Capillary Connection	Center Seal		___ 1 ___	•	•		
			Side Seal		___ 2 ___	9	9		
		Calibration Rings	None		___ A _	•	•		
	316L SS		___ B _	10	10				
	Hastelloy® C-276		___ C _	10	10				
	Monel 400®		___ D _	10	10				
Flushing Connections and Plugs ⁴ (Metal plug material will be the same as Cal. ring material if metal plug is chosen)	None		___ 0	•	•				
	One 1/4" with plastic plug		___ H	11	11				
	One 1/4" with metal plug		___ J	11	11				
	Two 1/4" with plastic plugs		___ M	11	11				
	Two 1/4" with metal plugs		___ N	11	11				
	One 1/2" with plastic plug		___ P	11	11				
	One 1/2" with metal plug		___ Q	11	11				
	Two 1/2" with plastic plugs		___ R	11	11				
	Two 1/2" with metal plugs		___ S	11	11				

Table II continued next page

^{**} Refer to 34-ST-00-128 for additional options, consult factory

¹ Standard facing 125-250 AARH RF (raised face) serrated surface finish.

⁴ Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

⁵ Tantalum Upper insert has Tantalum wetted parts and 316 SS or CS non-wetted parts

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

STR74G
STR73D


TABLE II		Description				Selection		
Seals (continued)	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating ¹	Const. - See Spec. Figure 34-ST-03-104	Construction - See Spec. Figure 34-ST-03-104		
	 Flush Flanged Seal with Lower**	2.4"	1"	ANSI 150 ANSI 300	22 22	BCA _____ BCC _____	• •	• •
			1-1/2"	ANSI 150 ANSI 300	22 22	BGA _____ BGC _____	• •	• •
			2"	ANSI 150 ANSI 300	22 22	BDA _____ BDC _____	• •	• •
			3"	ANSI 150 ANSI 300	22 22	BFA _____ BFC _____	• •	• •
		2.9"	1/2"	ANSI 150	23	CAA _____	•	•
			1"	ANSI 150 ANSI 300	23 23	CCA _____ CCC _____	• •	• •
			1-1/2"	ANSI 150 ANSI 300	22 22	CGA _____ CGC _____	• •	• •
			2"	ANSI 150 ANSI 300	22 22	CDA _____ CDC _____	• •	• •
		4.1"	1/2"	ANSI 150	22	DAA _____	•	•
			1"	ANSI 150 ANSI 300	23 23	DCA _____ DCC _____	• •	• •
			1-1/2"	ANSI 150 ANSI 300	23 23	DGA _____ DGC _____	• •	• •
			2"	ANSI 150 ANSI 300	23 22	DDA _____ DDC _____	• •	• •
			3"	ANSI 150 ANSI 300	22 22	DFA _____ DFC _____	• •	• •
		Wetted Material	Diaphragm		Lower	Selection		
			316L SS		316L SS	--- BA ---	•	•
			Hastelloy® C-276		316L SS	--- BB ---	•	•
			Hastelloy® C-276		Hastelloy® C-276	--- BC ---	•	•
			Monel 400®		Monel 400®	--- BE ---	8	8
			Tantalum		316L SS	--- BF ---	8	8
			Tantalum		Hastelloy® C-276	--- BG ---	8	8
			Tantalum		Tantalum Clad	--- BH ---	13	13
		Non-Wetted Material (upper, upper insert)	Upper		Upper Insert	Selection		
			316L SS		316L SS	--- 4 ---	•	•
		Bolts ⁶	No Selection			--- 5 ---	•	•
			None			--- 0 ---	•	•
		Flushing Connections and Plugs ⁴ (Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)	One 1/4" with plastic plug			--- H ---	•	•
			One 1/4" with metal plug			--- J ---	•	•
			Two 1/4" with plastic plugs			--- M ---	•	•
			Two 1/4" with metal plugs			--- N ---	•	•
			One 1/2" with plastic plug			--- P ---	•	•
			One 1/2" with metal plug			--- Q ---	•	•
			Two 1/2" with plastic plugs			--- R ---	•	•
			Two 1/2" with metal plugs			--- S ---	•	•
		Gasket	Klinger® C-4401 (non-asbestos)			--- K ---	•	•
			Grafoil®			--- G ---	•	•
			Teflon®			--- T ---	•	•
			Gylon® 3510			--- L ---	15	15

Table II continued next page

^{**} Refer to 34-ST-00-128 for additional options, consult factory

¹ Standard facing 125-250 AARH RF (raised face) serrated surface finish.

⁶ Bolt material will be same as Upper Material. However, if Table I bolts/nuts material is NACE or B7M, seal bolt material will be 304 SS NACE.

⁴ Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.


							STR74G	
							STR73D	
TABLE II		Description						
Seals (continued)	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating ¹		Selection		
		2.8"	3" (2.8" OD extension)	ANSI Class 150		EFA _ _ _ _ _	•	•
				ANSI Class 300		EFC _ _ _ _ _	•	•
				DIN DN80-PN40		EFM _ _ _ _ _	•	•
		3.5"	(3.70" OD extension)	ANSI Class 150		FGA _ _ _ _ _	•	•
				ANSI Class 300		FGC _ _ _ _ _	•	•
				DIN DN100-PN40		FGP _ _ _ _ _	•	•
		Wetted Material		Diaphragm	Ext. Tube	Selection		
				316L SS	316L SS	_ _ _ _ EA _ _ _ _	•	•
				Hastelloy® C-276	316L SS	_ _ _ _ EB _ _ _ _	•	•
				Hastelloy® C-276	Hastelloy® C-276	_ _ _ _ EC _ _ _ _	•	•
		Non-Wetted Material (flange)		CS (Nickel Plated)		_ _ _ _ _ 7 _ _ _ _	•	•
				316L SS		_ _ _ _ _ 8 _ _ _ _	•	•
	Bolts		No Selection		_ _ _ _ _ 0 _ _ _ _	•	•	
	Extension Length		2"		_ _ _ _ _ 2 _ _ _ _	•	•	
4"			_ _ _ _ _ 4 _ _ _ _	•	•			
6"			_ _ _ _ _ 6 _ _ _ _	•	•			
No Selection	No Selection	No Selection		_ _ _ _ _ 0 _ _ _ _	•	•		

Table II continued below

						STR74G			
						STR73D			

Table II continued below

^{**} Refer to 34-ST-00-128 for additional options, consult factory

¹ Standard facing 125-250 AARH RF (raised face) serrated surface finish.

⁴ Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

⁷ Tantalum Body has Tantalum wetted parts and 316 SS non-wetted parts

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.



TABLE II		Description				STR74G		STR73D	
Seals (continued)	Seal Type	Diaphragm Diameter	Flange Size	Flange Pressure Rating ¹		Selection			
	 Chemical Tee "Taylor" Wedge	3.5"	Taylor Wedge 5" O.D.	750 psi		HMO _____	16		
		Wetted Material		Diaphragm	Body	Selection			
				316L SS	316L SS	___ HA ___	•		
				Hastelloy® C-276	316L SS	___ HB ___	•		
				Hastelloy® C-276	Hastelloy® C-276	___ HC ___	•		
		Non-Wetted Material		No Selection		___ 0 ___	•		
		Bolts		No Selection		___ 0 ___	•		
		Styles		No Selection		___ 0 ___	•		
		No Selection		No Selection		___ 0 ___	•		

Table II continued next page

TABLE II		Description				STR74G		STR73D		
Seals (continued)	Seal Type	Diaphragm Diameter	Threaded Process Connection Size (NPT Female)	Pressure Rating		Selection				
				CS Bolts	304 SS Bolts					
	 Seal with Threaded Process Connection	2.4"	1/2 NPT	2,500 psi	1,250 psi	JJG _____	•	•		
			3/4 NPT			JKG _____	•	•		
			1 NPT			JLG _____	•	•		
		2.9"	1/2 NPT	2,500 psi	1,250 psi	KJG _____	•	•		
			3/4 NPT			KKG _____	•	•		
			1 NPT			KLK _____	•	•		
		4.1"	1/2 NPT	1,500 psi	750 psi	LJG _____	•	•		
			3/4 NPT			LKG _____	•	•		
			1 NPT			LLG _____	•	•		
		Wetted Material	Diaphragm		Lower		Selection			
			316L SS		Carbon Steel		____ JA ____		•	•
			316L SS		316L SS		____ JB ____		•	•
			Hastelloy® C-276		316L SS		____ JC ____		•	•
			Hastelloy® C-276		Hastelloy® C-276		____ JD ____		•	•
			Monel 400®		Monel 400®		____ JE ____		8	8
			Tantalum		316L SS		____ JF ____		8	8
			Tantalum		Hastelloy® C-276		____ JG ____		8	8
		Non-Wetted Material (upper)		CS (Nickel Plated)		____ A ____		•	•	
				316 Stainless Steel		____ C ____		17	17	
		Bolts ⁸		Carbon Steel		____ D ____		•	•	
				304 SS		____ E ____		•	•	
		Flushing Connections and Plugs ⁴		None		____ 0 ____		•	•	
		(Metal plug material will be the same as Lower material, if metal plug is chosen - (SS Plug for CS Lower and Tantalum Clad)		One 1/4" with plastic plug		____ H ____		•	•	
				One 1/4" with metal plug		____ J ____		•	•	
				Two 1/4" with plastic plugs		____ M ____		•	•	
				Two 1/4" with metal plugs		____ N ____		•	•	
				One 1/2" with plastic plug		____ P ____		18	18	
				One 1/2" with metal plug		____ Q ____		18	18	
				Two 1/2" with plastic plugs		____ R ____		18	18	
				Two 1/2" with metal plugs		____ S ____		18	18	
		Gasket	Klinger® C-4401 (non-asbestos)		____ K ____		•	•		
			Grafoil®		____ G ____		•	•		
			Teflon®		____ T ____		•	•		
			Gylon® 3510		____ L ____		15	15		

¹ Standard facing 125-250 AARH RF (raised face) serrated surface finish.

⁴ Plastic Plugs are TEMPORARY ONLY to protect threads and MUST be REMOVED before installation

⁸ If Table I Bolts and Nuts material option is NACE, Bolts and Nuts will ship with Alloy Steel NACE and MAWP may change.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.



TABLE II		Description						
Seals (continued)	Seal Type	Diaphragm Diameter	Flange Size	Pressure Rating		Selection	STR74G	STR73D
	 Sanitary Seal	1.9"	2"	Customer clamp rating or 600 psi, whichever is less		MD0 _____	20	19
		2.4"	2-1/2"			NE0 _____	19	19
		2.9"	3"			PF0 _____	19	19
		4.1"	4"			QG0 _____	19	19
		Wetted Material		Diaphragm	Body	Selection		
				316L SS	316L SS	___ N A ___	•	•
		Non-Wetted Material		No Selection		___ 0 ___	•	•
		Bolts		No Selection		___ 0 ___	•	•
		Styles		Tri-Clover Tri-Clamp®		___ 8 ___	•	•
	Gasket		No Selection			___ 0 ___	•	•

TABLE II		Description					STR74G STR73D	
Seals (continued)	Seal Type	Diaphragm Diameter	Size and Bolt Pattern	Seal Pressure Rating		Selection		
				C.S. Bolts	304 SS Bolts			
	 Saddle Seal	2.4" 8-Bolt Design	for 3" Pipe ≥ 4" pipe	2,500 psi	1,250 psi	RFK _____ RGK _____	•	•
		2.4" 6-Bolt Design	for 3" Pipe ≥ 4" pipe	2,000 psi	1,000 psi	RPK _____ RQK _____	•	•
		Wetted Material		Diaphragm	Lower Housing	Selection		
				316L SS	Carbon Steel	___ RA ___	•	•
				316L SS	316L SS	___ RB ___	•	•
				Hastelloy® C-276	316L SS	___ RC ___	•	•
				Hastelloy® C-276	Hastelloy® C-276	___ RD ___	•	•
				316L SS	N/A-Body Only ¹⁰	___ SB ___	•	•
				Hastelloy® C-276	N/A-Body Only ¹⁰	___ SC ___	•	•
		Non-Wetted Material		Body	Bolts ^{10,11}	Selection		
				Carbon Steel	Carbon Steel	___ B ___	8	8
				316L SS	316 SS	___ C ___	•	•
		Bolts		No Selection			___ 0 ___	•
Styles		No Selection			___ 0 ___	•	•	
Gasket		Klinger® C-4401 (non-asbestos)			___ K ___	•	•	
		Grafoil®			___ G ___	•	•	
		Teflon®			___ T ___	•	•	
		Gylon® 3510			___ L ___	•	•	

⁹ All sanitary seals have dairy grade 3A approval.

¹⁰ Bolts are not included with "body only" selection.

¹¹ If Table I Bolts and Nuts material option is NACE, seal bolt material will be 304 SS NACE.

Note: Remote seal system pressure rating is body rating or seal rating, whichever is less.

STR74G
STR73D

TABLE III	Agency Approvals (see data sheet for Approval Code Details)
Approvals	No Approvals Required FM Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof CSA Explosion proof, Intrinsically Safe, Non-incendive, & Dustproof ATEX Explosion proof, Intrinsically Safe & Non-incendive IECEx Explosion proof, Intrinsically Safe & Non-incendive SAEEx Explosion proof, Intrinsically Safe & Non-incendive INMETRO Explosion proof, Intrinsically Safe & Non-incendive NEPSI Explosion proof, Intrinsically Safe & Non-incendive KOSHA Explosion proof, Intrinsically Safe & Non-incendive EAC Customs Union(Russia,Belarus,Kazakhstan)Ex Approval,Flame proof, Intrinsically Sa CCoE Explosion proof, Intrinsically Safe & Non-incendive UATR Flameproof, Intrinsically Safe & Dustproof

0	•	•
A	•	•
B	•	•
C	•	•
D	•	•
E	•	•
F	•	•
G	•	•
H	•	•
I	•	•
J	•	•
K	•	•

TABLE IV	TRANSMITTER ELECTRONIC SELECTIONS		
a. Electronic Housing Material & Connection Type	Material	Connection	Lightning Protection
	Polyester Powder Coated Aluminum	1/2 NPT	None
	Polyester Powder Coated Aluminum	M20	None
	Polyester Powder Coated Aluminum	1/2 NPT	Yes
	Polyester Powder Coated Aluminum	M20	Yes
	316 Stainless Steel (Grade CF8M)	1/2 NPT	None
	316 Stainless Steel (Grade CF8M)	M20	None
	316 Stainless Steel (Grade CF8M)	1/2 NPT	Yes
	316 Stainless Steel (Grade CF8M)	M20	Yes
b. Output/ Protocol	Analog Output		Digital Protocol
	4-20mA dc		HART Protocol
	4-20mA dc none		DE Protocol Foundation Fieldbus
c. Customer Interface Selections	Indicator	Ext Zero, Span & Config Buttons	Languages
	None	None	None
	None	Yes (Zero/Span Only)	None
	Basic	None	English
	Basic	Yes	English
	Standard (w/internal Zero, Span & Conf Buttons)	None	English

A _ _	•	•
B _ _	•	•
C _ _	•	•
D _ _	•	•
E _ _	•	•
F _ _	•	•
G _ _	•	•
H _ _	•	•

_ H _	•	•
_ D _	•	•
_ F _	•	•

_ _ 0	•	•
_ _ A	f	f
_ _ B	•	•
_ _ C	•	•
_ _ D	u	u

TABLE V	CONFIGURATION SELECTIONS		
a. Application Software	Diagnostics		
	Standard Diagnostics		
b. Output Limit, Failsafe & Write Protect Settings	Write Protect	Fail Mode	High & Low Output Limits ³
	Disabled	High> 21.0mAdc	Honeywell Std (3.8 - 20.8 mAdc)
	Disabled	Low< 3.6mAdc	Honeywell Std (3.8 - 20.8 mAdc)
	Enabled	High> 21.0mAdc	Honeywell Std (3.8 - 20.8 mAdc)
	Enabled	Low< 3.6mAdc	Honeywell Std (3.8 - 20.8 mAdc)
	Enabled	N/A	N/A Fieldbus
	Disabled	N/A	N/A Fieldbus
c. General Configuration	Factory Standard		
	Custom Configuration (Unit Data Required from customer)		

1 _ _	•	•
-------	---	---

_ 1 _	f	f
_ 2 _	f	f
_ 3 _	f	f
_ 4 _	f	f
_ 5 _	g	g
_ 6 _	g	g
_ _ S	•	•
_ _ C	•	•

TABLE VI	CALIBRATION & ACCURACY SELECTIONS		
Accuracy and Calibration	Accuracy	Calibrated Range	Calibration Qty
	NA	None	None
	Standard	Factory Std	Single Calibration
	Standard	Custom (Unit Data Required)	Single Calibration

0	21	21
A	•	•
B	•	•

³ NAMUR Output Limits 3.8 - 20.5mAdc can be configured by the customer or select custom configuration Table Vc




TABLE VII	ACCESSORY SELECTIONS	
a. Mounting Bracket	Bracket Type	Material
	None	None
	Angle Bracket	Carbon Steel
	Angle Bracket	304 SS
	Angle Bracket	316 SS
	Marine Approved Bracket	Carbon Steel
	Marine Approved Bracket (In - Line)	Carbon Steel
	Marine Approved Bracket	304 SS
	Marine Approved Bracket (In - Line)	304 SS
	Flat Bracket	Carbon Steel
	Flat Bracket	304 SS
	Flat Bracket	316 SS
b. Customer Tag	Customer Tag Type	
	No customer tag	
	One Wired Stainless Steel Tag (Up to 4 lines 26 char/line)	
c. Unassembled Conduit Plugs & Adapters	Unassembled Conduit Plugs & Adapters	
	No Conduit Plugs or Adapters Required	
	1/2 NPT Male to 3/4 NPT Female 316 SS Certified Conduit Adapter	
	1/2 NPT 316 SS Certified Conduit Plug	
	M20 316 SS Certified Conduit Plug	
	Minifast® 4 pin (1/2 NPT)	
	Minifast® 4 pin (M20)	

0	---	•	•
1	---	•	•
2	---	•	•
3	---	•	•
8	---	y	•
9	---	•	•
4	---	y	•
A	---	•	•
5	---	•	•
6	---	•	•
7	---	•	•

-	0	---	•	•
-	1	---	•	•
-	2	---	•	•

--	A0	•	•
--	A2	n	n
--	A6	n	n
--	A7	m	m
--	A8	n	n
--	A9	m	m

TABLE VIII	OTHER Certifications & Options : (String in sequence comma delimited (XX, XX, XX,....))
Certifications & Warranty	None - No other options
	NACE MR0175; MR0103; ISO15156 (FC33338) Process wetted parts only
	NACE MR0175; MR0103; ISO15156 (FC33339) wetted and non-wetted parts
	Marine (DNV,ABS,BV,KR,LR)
	EN10204 Type 3.1 Material Traceability (FC33341)
	Certificate of Conformance (F3391)
	Calibration Test Report & Certificate of Conformance (F3399)
	Certificate of Origin (F0195)
	FMEDA (SIL 2/3) Certification (FC33337)
	Over-Pressure Leak Test Certificate (1.5X MAWP) (F3392)
	Cert Clean for O2 or CL2 service per ASTM G93
	Extended Warranty Additional 1 year
	Extended Warranty Additional 2 years
	Extended Warranty Additional 3 years
	Extended Warranty Additional 4 years

00	*	*	
FG	•	•	b
F7	c	c	
MT	d	d	
FX	•	•	b
F3	•	•	
F1	•	•	
F5	•	•	b
FE	j	j	
TP	•	•	
OX	e	e	b
01	•	•	
02	•	•	
03	•	•	
04	•	•	

TABLE IX	Manufacturing Specials
Factory	Factory Identification

0	0	0	0	•	•
---	---	---	---	---	---

MODEL RESTRICTIONS

Restriction Letter	Available Only With		Not Available With	
	Table	Selection(s)	Table	Selection(s)
b		Select only one option from this group		
d			VIIa	1,2,3,5,6,7 _ _ _
c	Id	_ _ _ 0, N, B _ _ _		
e	Ib	_ 2 _ _ 2 _ _		
f			IVb	_ F _
g			IVb	_ H, D _
j	IVb	_ H _	Vb	_ 1,2,6 _
m	IVa	B, D, F, H _ _		
n	IVa	A, C, E, G _ _		
u	IVb	_ H _		
y			Ic	_ _ E _ _ _
2	Ie	<div> <div>0</div> <div>2</div> <div>4</div> </div>		
3	If	_ _ _ _ 2 _	Ia	2 _ _ _ _ _
4	I	2 _ _ 0 _ _		
5	II	000000000	VIII	FG, F7, FX, OX, TP, MT, F1
6	I	_ _ B, D _ _ _	Ia	2 _ _ _ _ _
7			II	<div>AF</div> <div>BF</div> <div>BG</div> <div>BH</div> <div>GG</div> <div>JF</div> <div>JG</div>
8			VIII	FG, F7
9	II	<div>AA2</div> <div>AB2</div>		
10			II	_ _ _ _ _ 0
11			II	_ _ _ _ _ A _
13	II	_ _ _ _ _ 0 _	II	_ _ _ _ _ T
			VIII	FG, F7
15	II	<div>BF</div> <div>BG</div> <div>BH</div> <div>JF</div> <div>JG</div>		
16	I	2 _ _ _ _ _		
17			II	_ _ _ JA _ _ _
18			II	<div>JJG</div> <div>JKG</div> <div>JLG</div>
19			If	_ _ _ _ 2 _
20	If	_ _ _ _ A, G _		
21	I	_ _ _ _ 000		
22	Ic	_ _ E _ _ _		
23			II	000000000

FM ApprovalsSM is a service mark of FM Global

Hastelloy[®] is a registered trademark of Haynes International

Monel 400[®] is a registered trademark of Special Metals Corporation.

HART[®] is a registered trademark of HART Communication Foundation.

FOUNDATIONTM Fieldbus is a registered trademark of Fieldbus Foundation.

Teflon[®] is a registered trademark of DuPont.

Neobee[®] is a registered trademark of Stepan Company.

Syltherm[®] 800 is a Trademark of Dow Corning Corporation

Klinger[®] C-4401 is a registered trademark of THERMOSEAL, INC

GRAFOIL[®] is a registered trademarks of GrafTech International Holdings Inc

Gylon[®] 3510 is registered trademark of Garlock Sealing Technologies

Tri-Clover Tri-Clamp[®] is a registered trademark of Alfa-Laval

FIELD INSTALLABLE REPLACEMENT PARTS

Description	Kit Number
Integrally Mounted Basic Indicator Kit (Compatible with all Electronic Modules)	50049911-501
Terminal Strip w/Lightning Protection Kit for HART or DE Modules	50075472-532
Terminal Strip w/Lightning Protection Kit for FFB/ <i>Profibus</i> Module	50075472-534
Terminal Strip w/o Lightning Protection for HART or DE Modules	50075472-531
Terminal Strip w/o Lightning Protection FFB Module	50075472-533
HART Electronics Module	50049849-501
HART Electronics Module w/connection for external configuration buttons	50049849-502
DE Electronics Module	50049849-503
DE Electronics Module w/connection for external configuration buttons	50049849-504
FFB Electronics Module Kit	50049849-509
FFB Electronics Module w/connection for external configuration buttons	50049849-510
Standard Display Module	50126003-501

PRODUCT MANUALS

Description	Part Number
ST 700 SmartLine Transmitter User Manual - English	34-ST-25-44
ST 700 SmartLine Transmitter HART/DE Communications Manual - English	34-ST-25-47
ST 700 SmartLine Transmitter Safety Manual - English	34-ST-25-37
ST 700 SmartLine Transmitter Foundation Fieldbus Manual - English	34-ST-25-48
ST 700 SmartLine Transmitter Function Block Manual - English	34-ST-25-49

All product documentation is available at www.honeywellprocess.com.

Sales and Service

For application assistance, current specifications, ordering, pricing, and name of the nearest Authorized Distributor, contact one of the offices below.

ASIA PACIFIC

Honeywell Process Solutions,
Phone: + 800 12026455 or
+44 (0) 1202645583

(TAC) hfs-tac-support@honeywell.com

Australia

Honeywell Limited
Phone: +(61) 7-3846 1255
FAX: +(61) 7-3840 6481
Toll Free 1300-36-39-36
Toll Free Fax:
1300-36-04-70

China – PRC - Shanghai

Honeywell China Inc.
Phone: (86-21) 5257-4568
Fax: (86-21) 6237-2826

Singapore

Honeywell Pte Ltd.
Phone: +(65) 6580 3278
Fax: +(65) 6445-3033

South Korea

Honeywell Korea Co Ltd
Phone: +(822) 799 6114
Fax: +(822) 792 9015

EMEA

Honeywell Process Solutions,
Phone: + 800 12026455 or
+44 (0) 1202645583

Email: (Sales)

FP-Sales-Apps@Honeywell.com

or

(TAC)

hfs-tac-support@honeywell.com

Web

Knowledge Base search
engine <http://bit.ly/2N5Vldi>

AMERICAS

Honeywell Process Solutions,
Phone: (TAC) (800) 423-9883
or (215) 641-3610
(Sales) 1-800-343-0228

Email: (Sales)

FP-Sales-Apps@Honeywell.com

or

(TAC)

hfs-tac-support@honeywell.com

Web

Knowledge Base search
engine <http://bit.ly/2N5Vldi>

Specifications are subject to change without notice.

For more information

To learn more about SmartLine Transmitters,
visit www.honeywellprocess.com
Or contact your Honeywell Account Manager

Process Solutions

Honeywell
1250 W Sam Houston Pkwy S
Houston, TX 77042

Honeywell Control Systems Ltd
Honeywell House, Skimped Hill Lane
Bracknell, England, RG12 1EB

Shanghai City Centre, 100 Jungi Road
Shanghai, China 20061

www.honeywellprocess.com



34-ST-03-104

October 2020

©2020 Honeywell International Inc.